



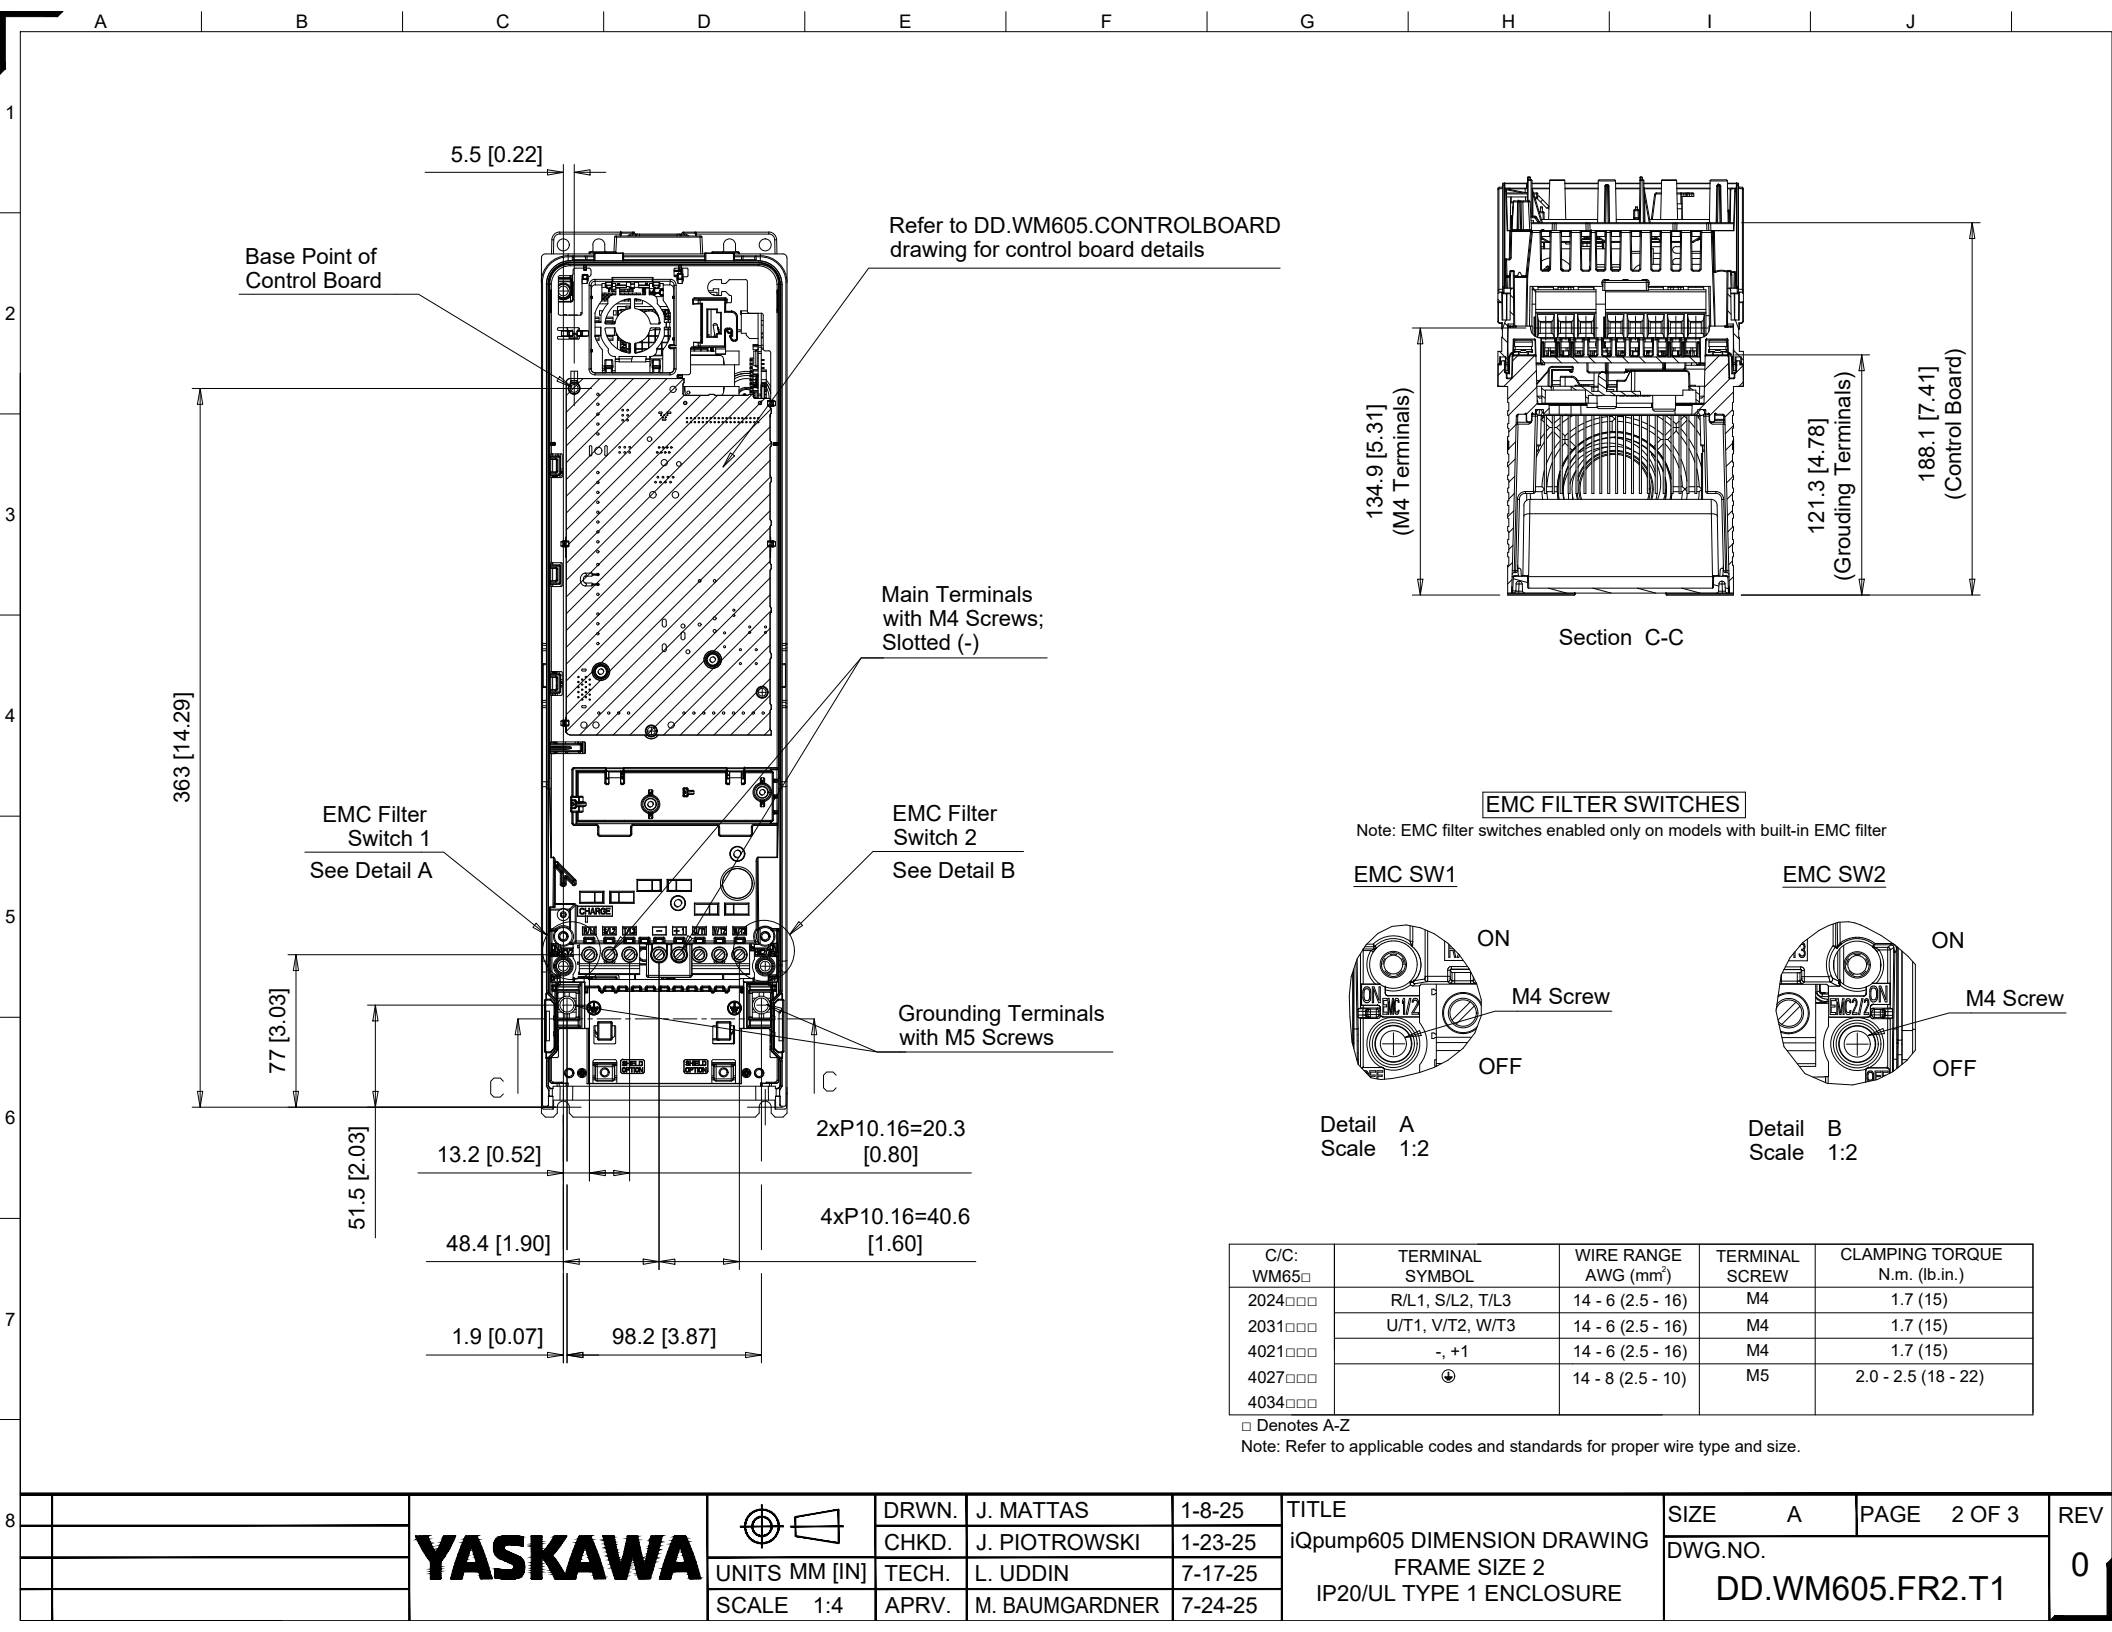


Minimum Installation Clearances (Scale 1:5)

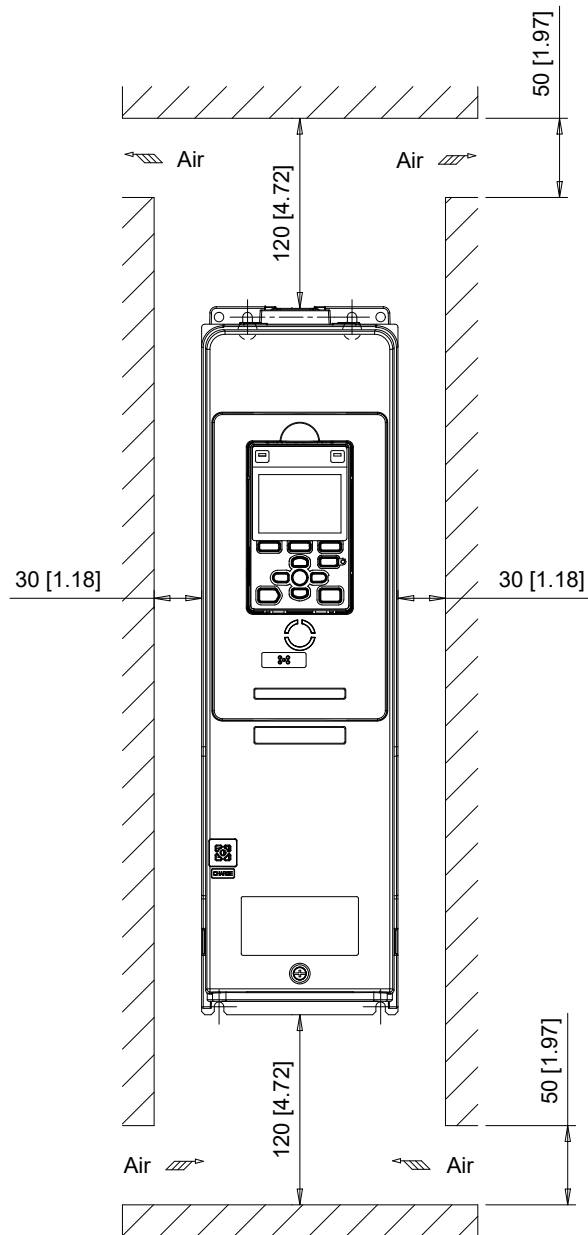


Note:
For alternate mounting configurations, consult manual.

Panel Cutout (Scale 1:4) For External Heatsink Mounting Configuration

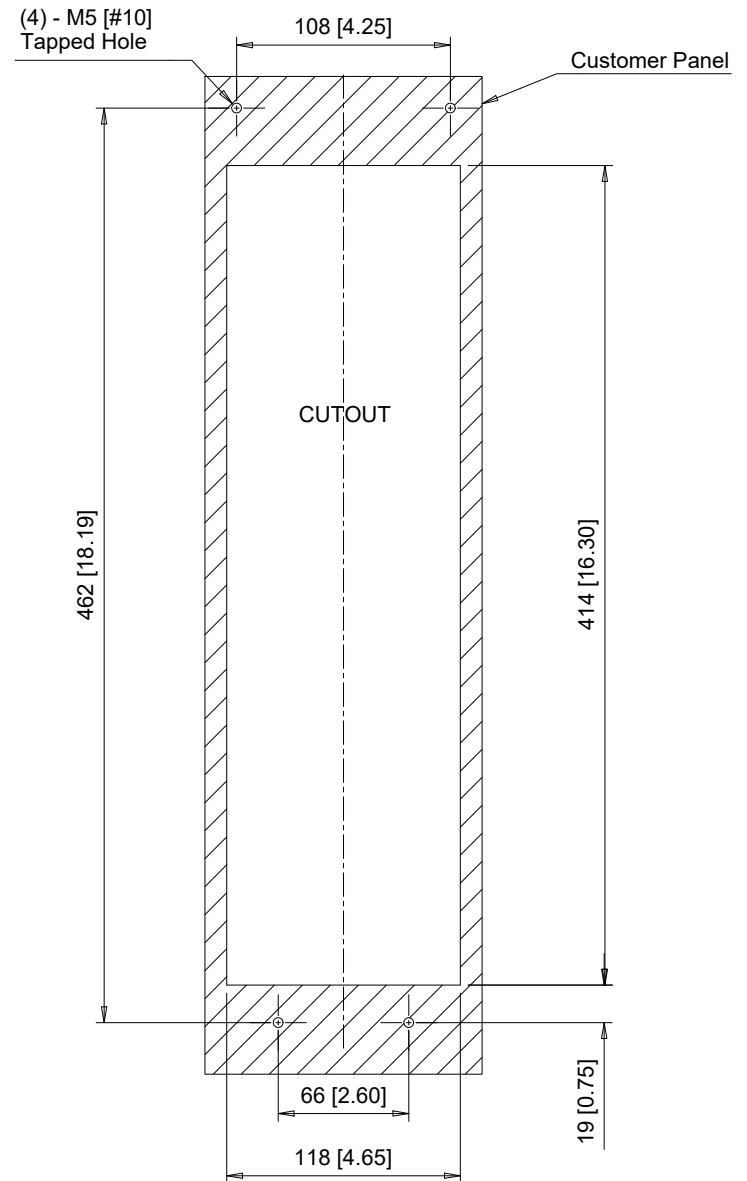

Notes:
Exposed heatsink minimum clearance D = 110 [4.33].
Refer to external heatsink instructions document for additional details.

YASKAWA



UNITS MM [IN]
SCALE ABOVE

DRWN.	J. MATTAS	1-8-25
CHKD.	J. PIOTROWSKI	1-23-25
TECH.	L. UDDIN	7-17-25
APRV.	M. BAUMGARDNER	7-24-25

TITLE
iQpump605 DIMENSION DRAWING
FRAME SIZE 2
IP20/UL TYPE 1 ENCLOSURE

SIZE	A	PAGE	3 OF 3
DWG.NO.	DD.WM605.FR2.T1		

REV
0