



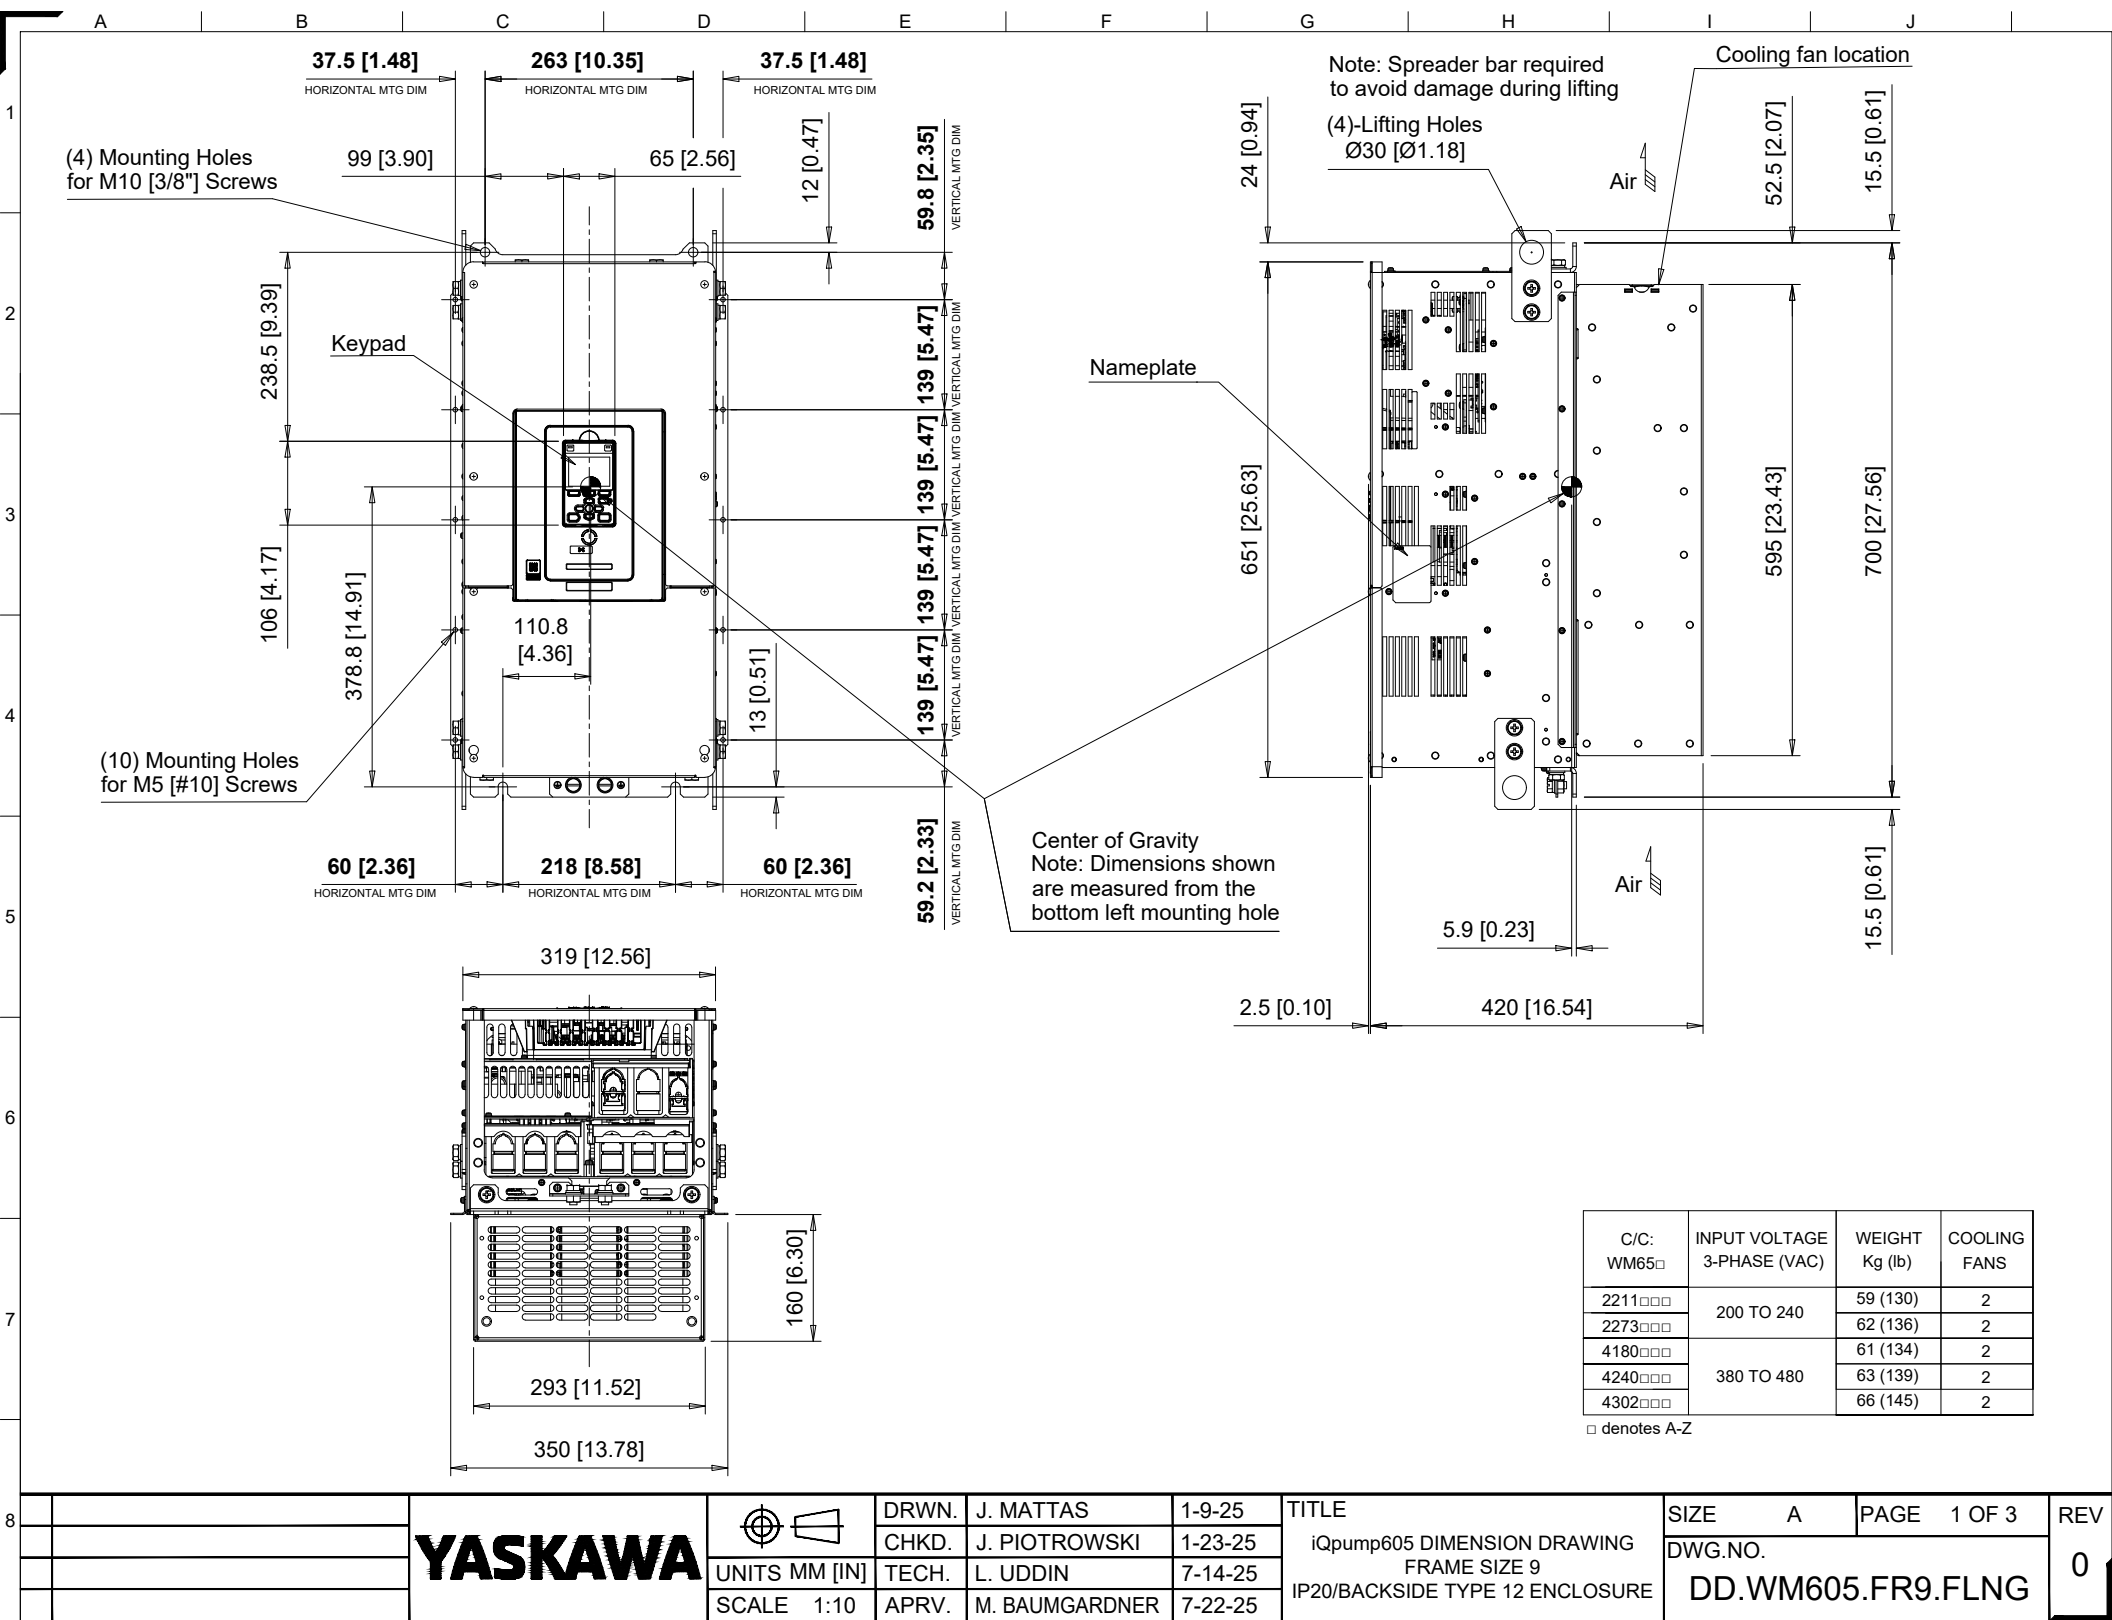

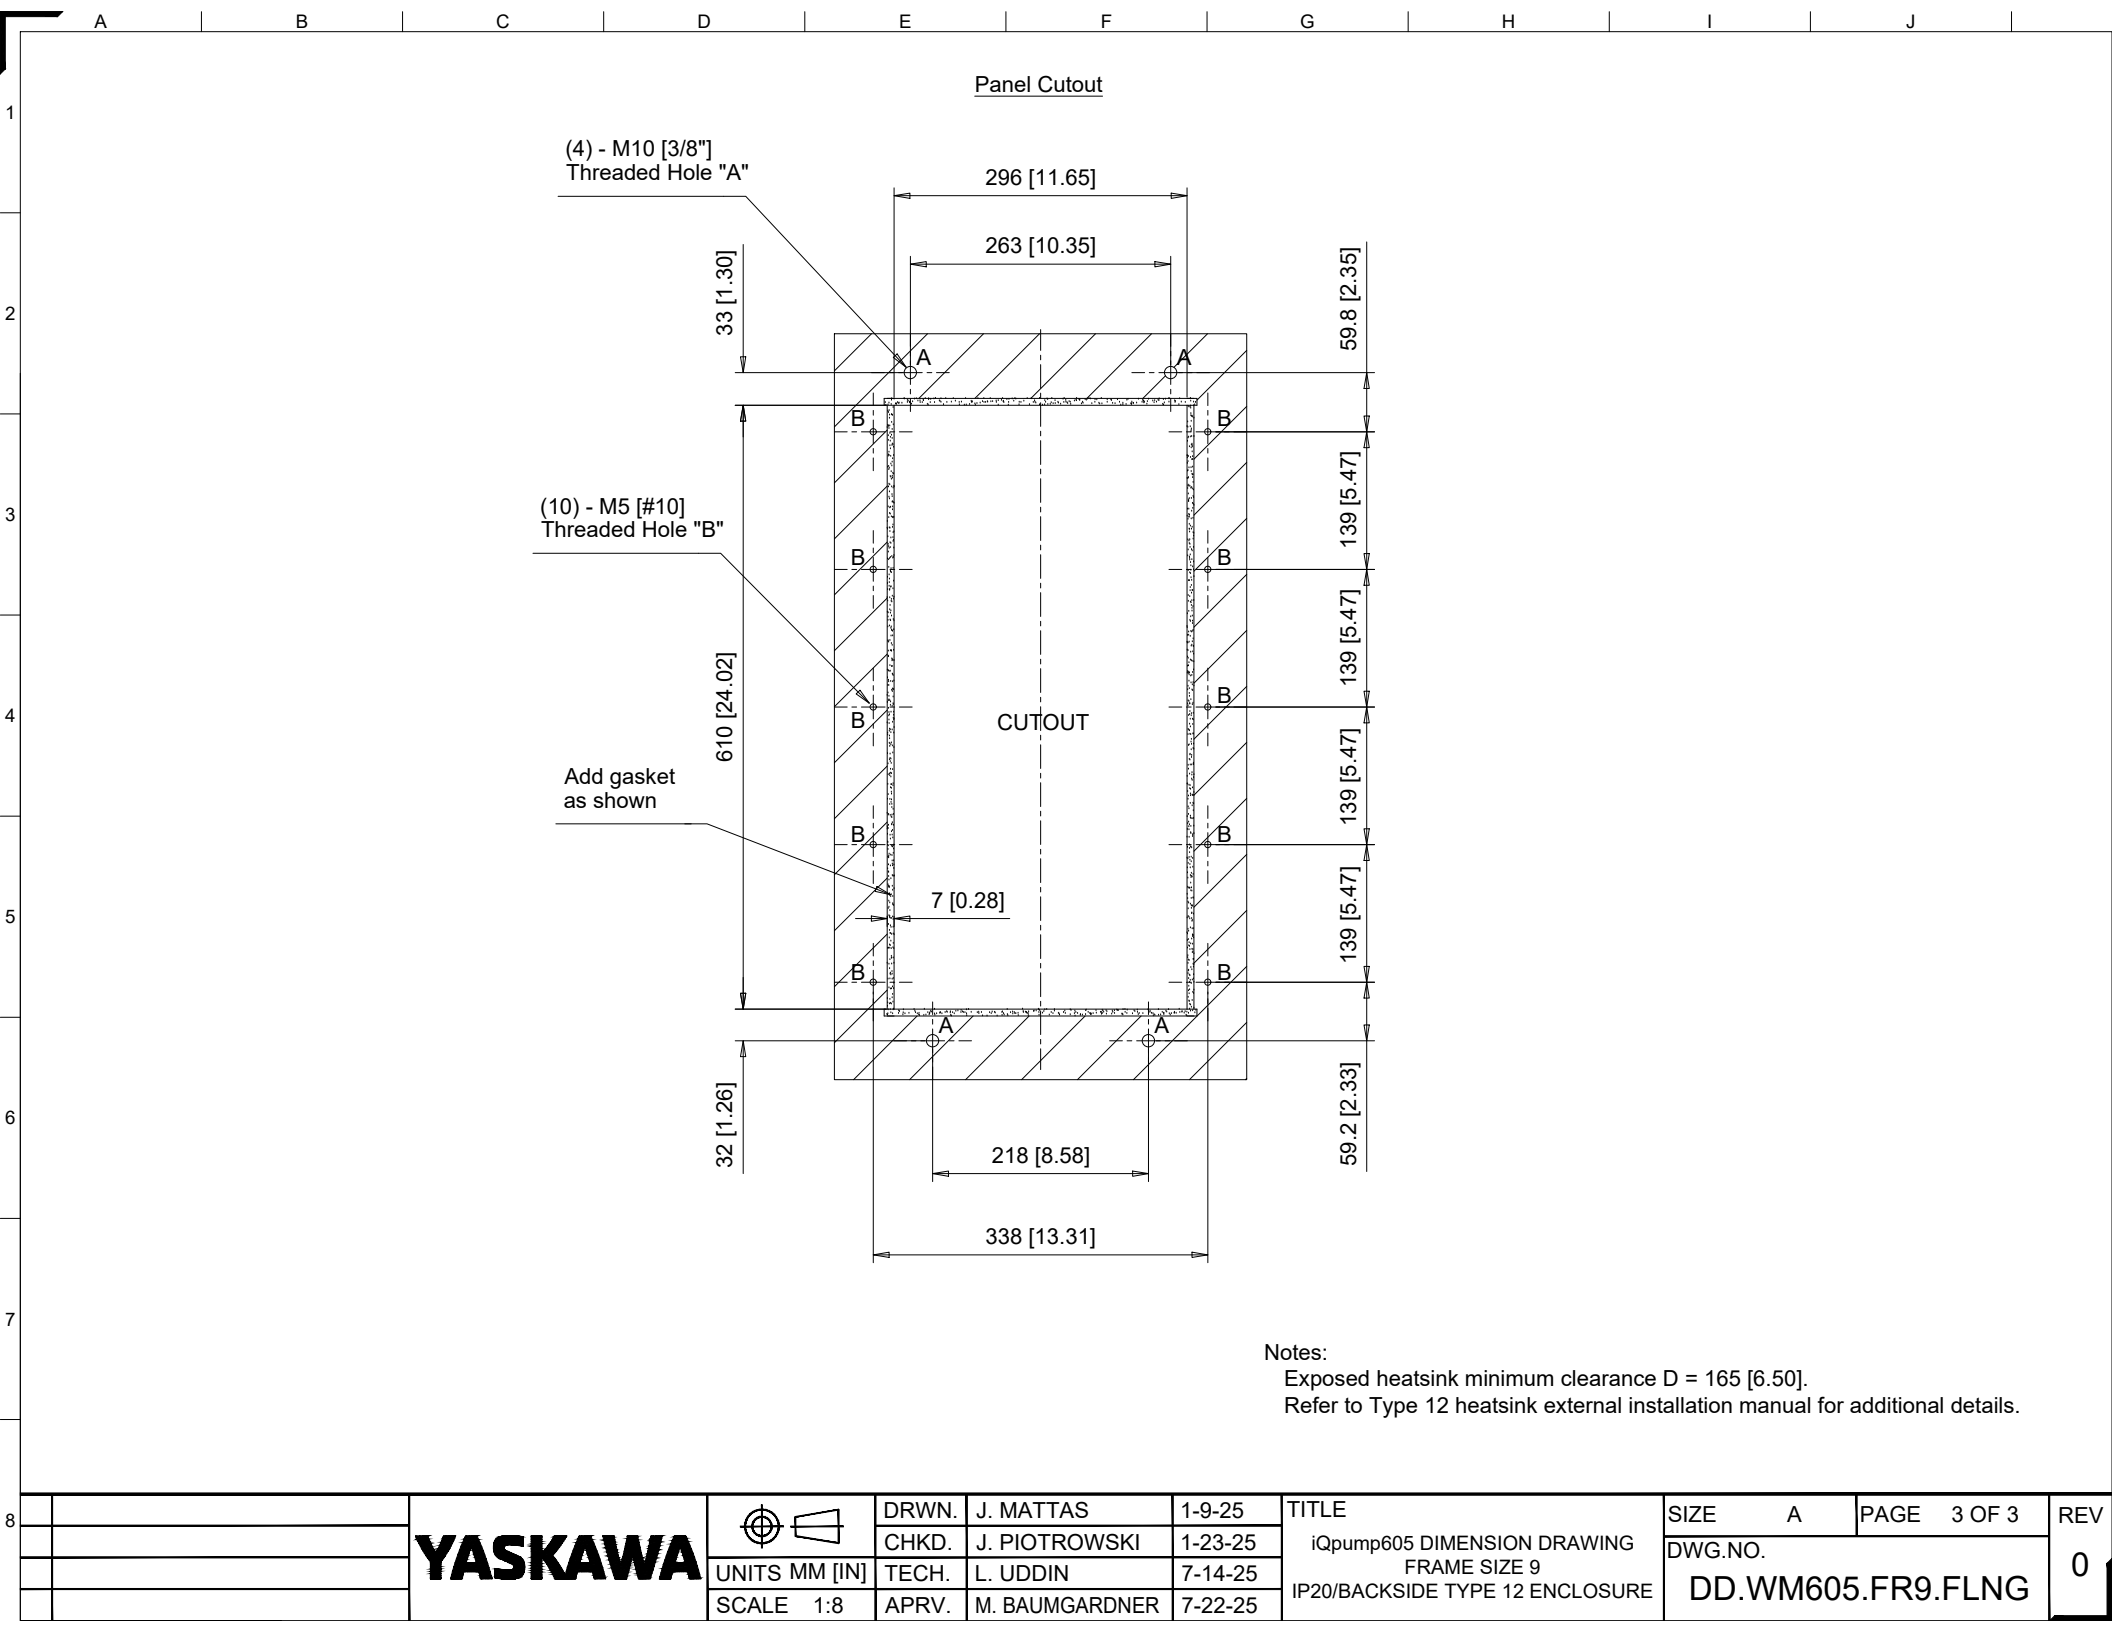

Notes:
Exposed heatsink minimum clearance D = 165 [6.50].
Refer to Type 12 heatsink external installation manual for additional details.

8		YASKAWA		DRWN.	J. MATTAS	1-9-25	TITLE iQpump605 DIMENSION DRAWING FRAME SIZE 9 IP20/BACKSIDE TYPE 12 ENCLOSURE	SIZE	A	PAGE	3 OF 3	REV
				CHKD.	J. PIOTROWSKI	1-23-25		DWG.NO.				0
				TECH.	L. UDDIN	7-14-25		DD.WM605.FR9.FLNG				
				SCALE	1:8	APRV.		M. BAUMGARDNER	7-22-25			