


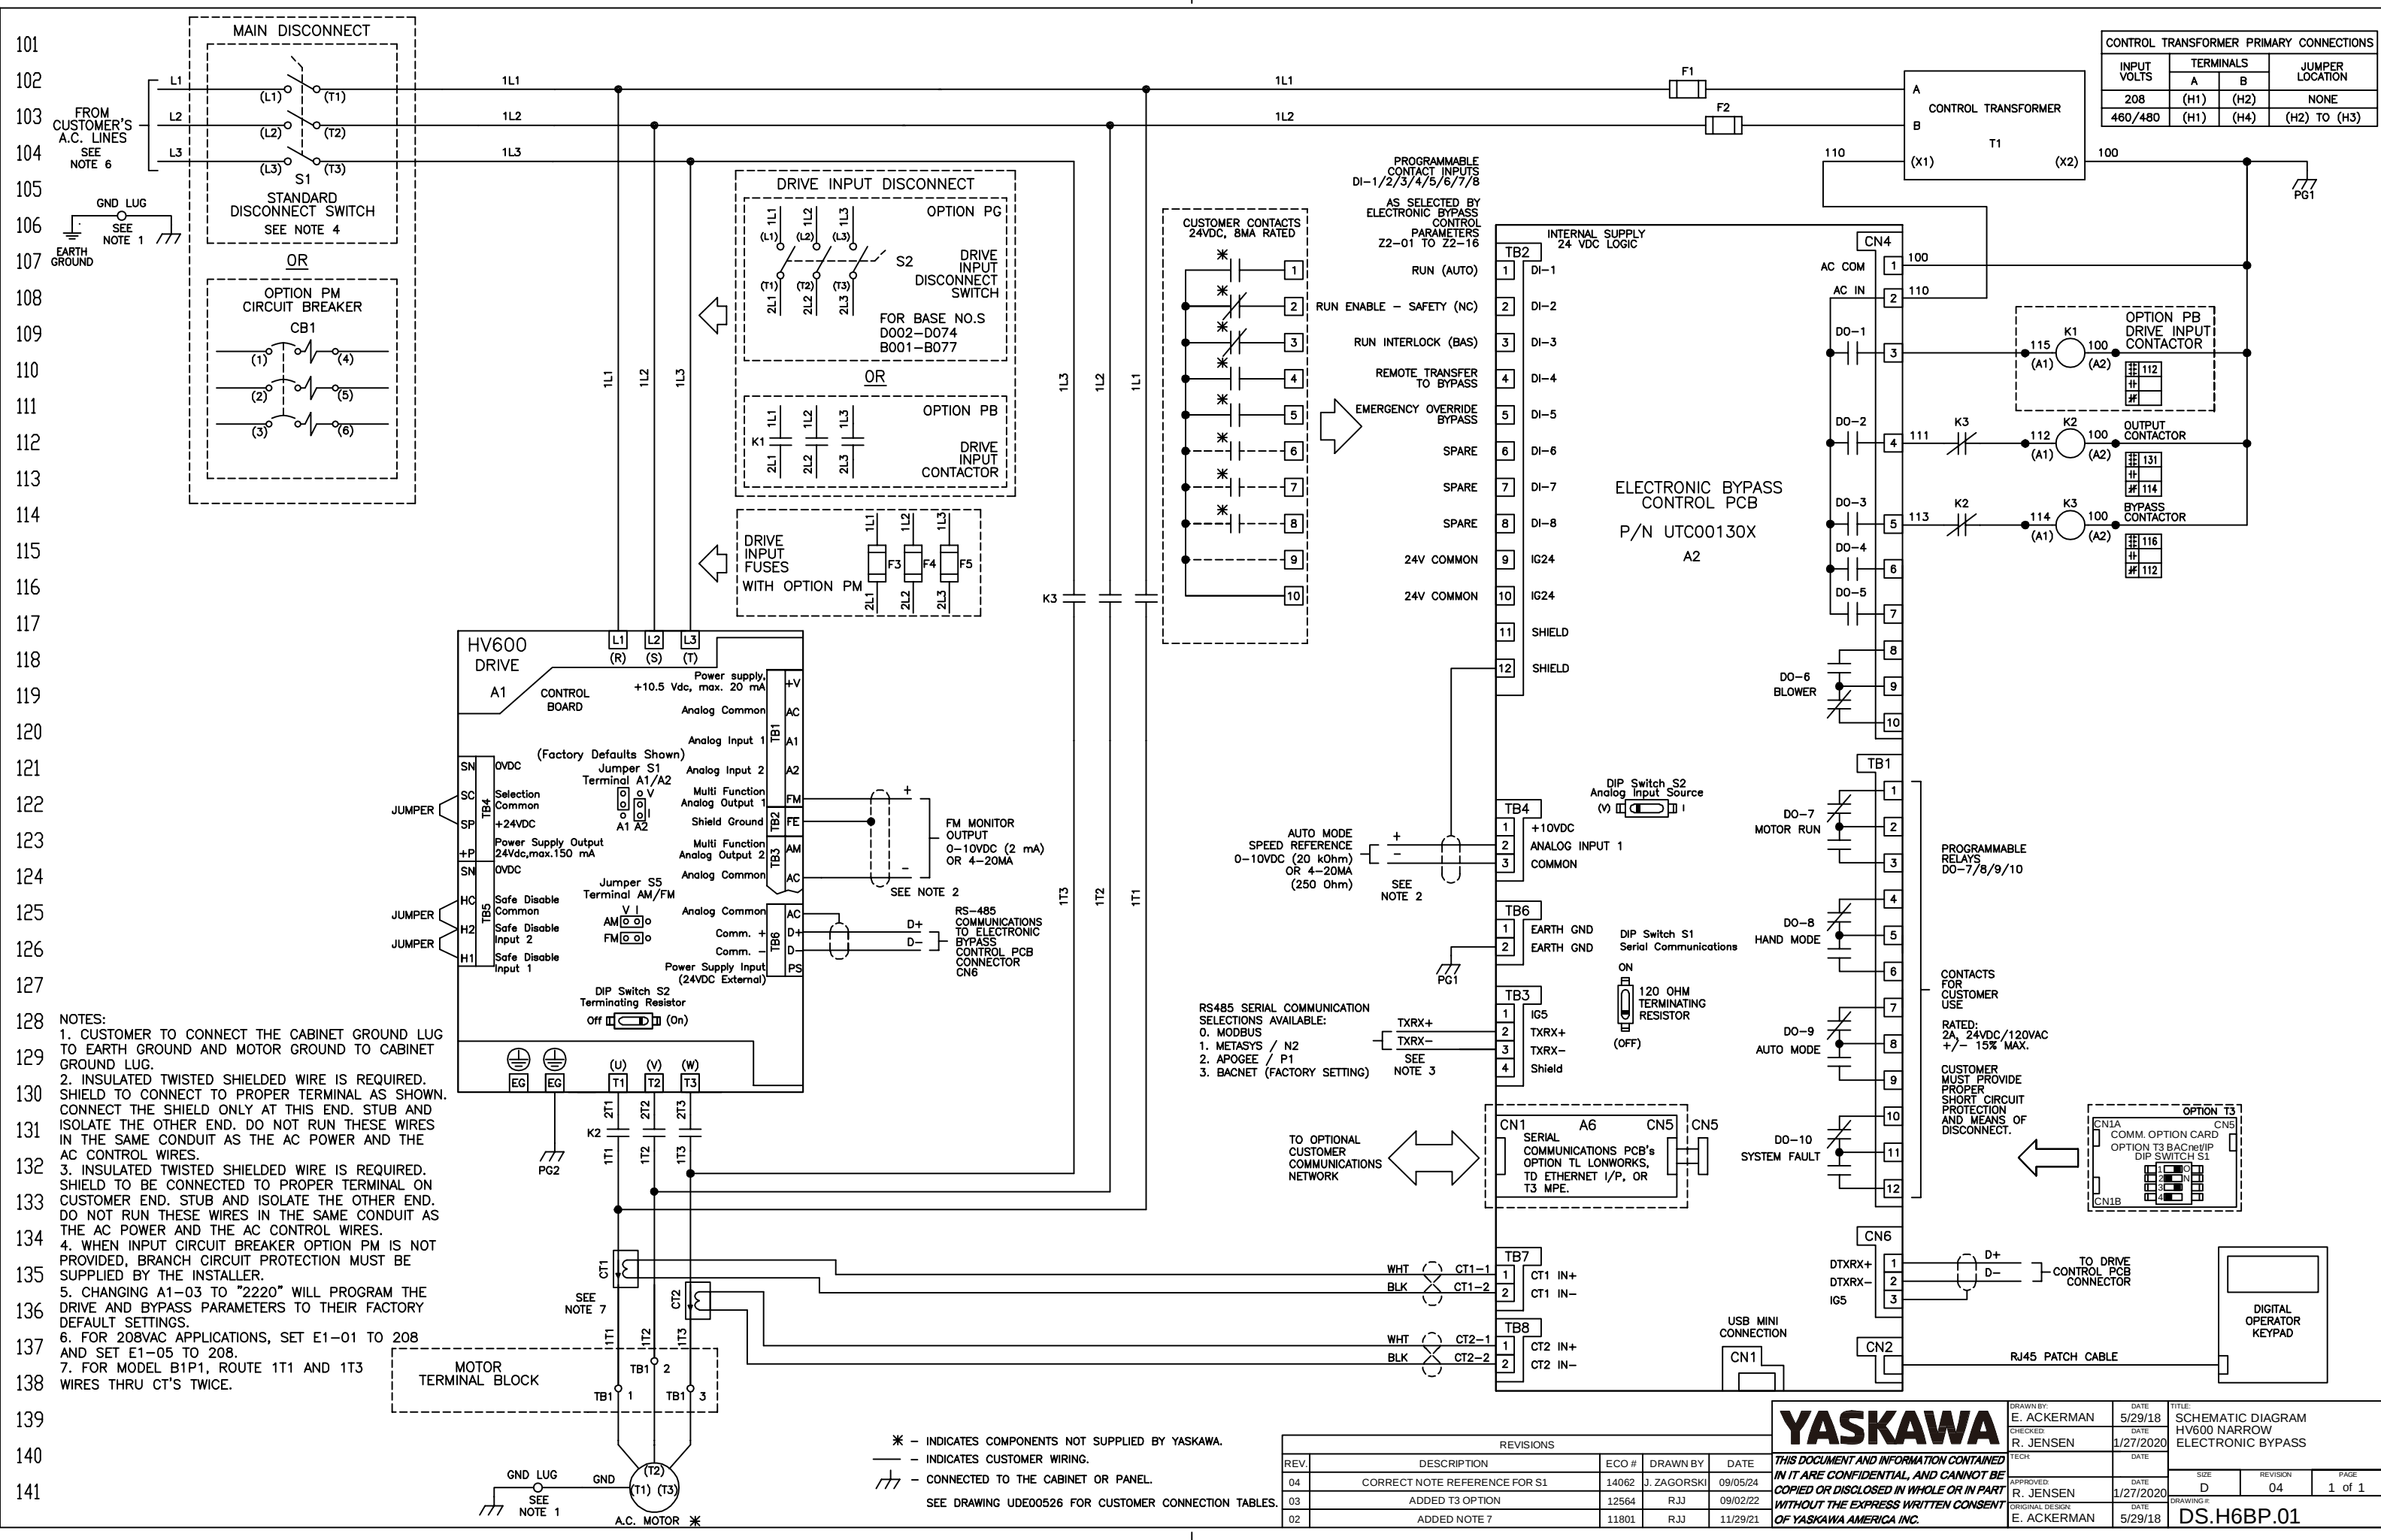

NOTES:

1. CUSTOMER TO CONNECT THE CABINET GROUND LUG TO EARTH GROUND AND MOTOR GROUND TO CABINET GROUND LUG.

2. INSULATED TWISTED SHIELDED WIRE IS REQUIRED. SHIELD TO CONNECT TO PROPER TERMINAL AS SHOWN. CONNECT THE SHIELD ONLY AT THIS END. STUB AND ISOLATE THE OTHER END. DO NOT RUN THESE WIRES IN THE SAME CONDUIT AS THE AC POWER AND THE AC CONTROL WIRES.

3. INSULATED TWISTED SHIELDED WIRE IS REQUIRED. SHIELD TO BE CONNECTED TO PROPER TERMINAL ON CUSTOMER END. STUB AND ISOLATE THE OTHER END. DO NOT RUN THESE WIRES IN THE SAME CONDUIT AS THE AC POWER AND THE AC CONTROL WIRES.

4. WHEN INPUT CIRCUIT BREAKER OPTION PM IS NOT PROVIDED, BRANCH CIRCUIT PROTECTION MUST BE SUPPLIED BY THE INSTALLER.

5. CHANGING A1-03 TO "2220" WILL PROGRAM THE DRIVE AND BYPASS PARAMETERS TO THEIR FACTORY DEFAULT SETTINGS.

6. FOR 208VAC APPLICATIONS, SET E1-01 TO 208 AND SET E1-05 TO 208.

7. FOR MODEL B1P1, ROUTE 1T1 AND 1T3 WIRES THRU CT'S TWICE.

* - INDICATES COMPONENTS NOT SUPPLIED BY YASKAWA.
- - - INDICATES CUSTOMER WIRING.
- - - CONNECTED TO THE CABINET OR PANEL.
SEE DRAWING UDE00526 FOR CUSTOMER CONNECTION TABLES.

REVISIONS				
REV.	DESCRIPTION	ECO #	DRAWN BY	DATE
04	CORRECT NOTE REFERENCE FOR S1	14062	J. ZAGORSKI	09/05/24
03	ADDED T3 OPTION	12564	RJJ	09/02/22
02	ADDED NOTE 7	11801	RJJ	11/29/21

YASKAWA

DRAWN BY:
E. ACKERMAN

CHECKED:
R. JENSEN

APPROVED:
R. JENSEN

ORIGINAL DESIGN:
E. ACKERMAN

DATE
5/29/18

DATE
1/27/2020

DATE
1/27/2020

DATE
5/29/18

TITLE
SCHEMATIC DIAGRAM
HV600 NARROW
ELECTRONIC BYPASS

SIZE
D

REVISION
04

PAGE
1 of 1

DRWING#
DS.H6BP.01

INPUT VOLTS	TERMINALS		JUMPER LOCATION
	A	B	
208	(H1)	(H2)	NONE
460/480	(H1)	(H4)	(H2) TO (H3)