


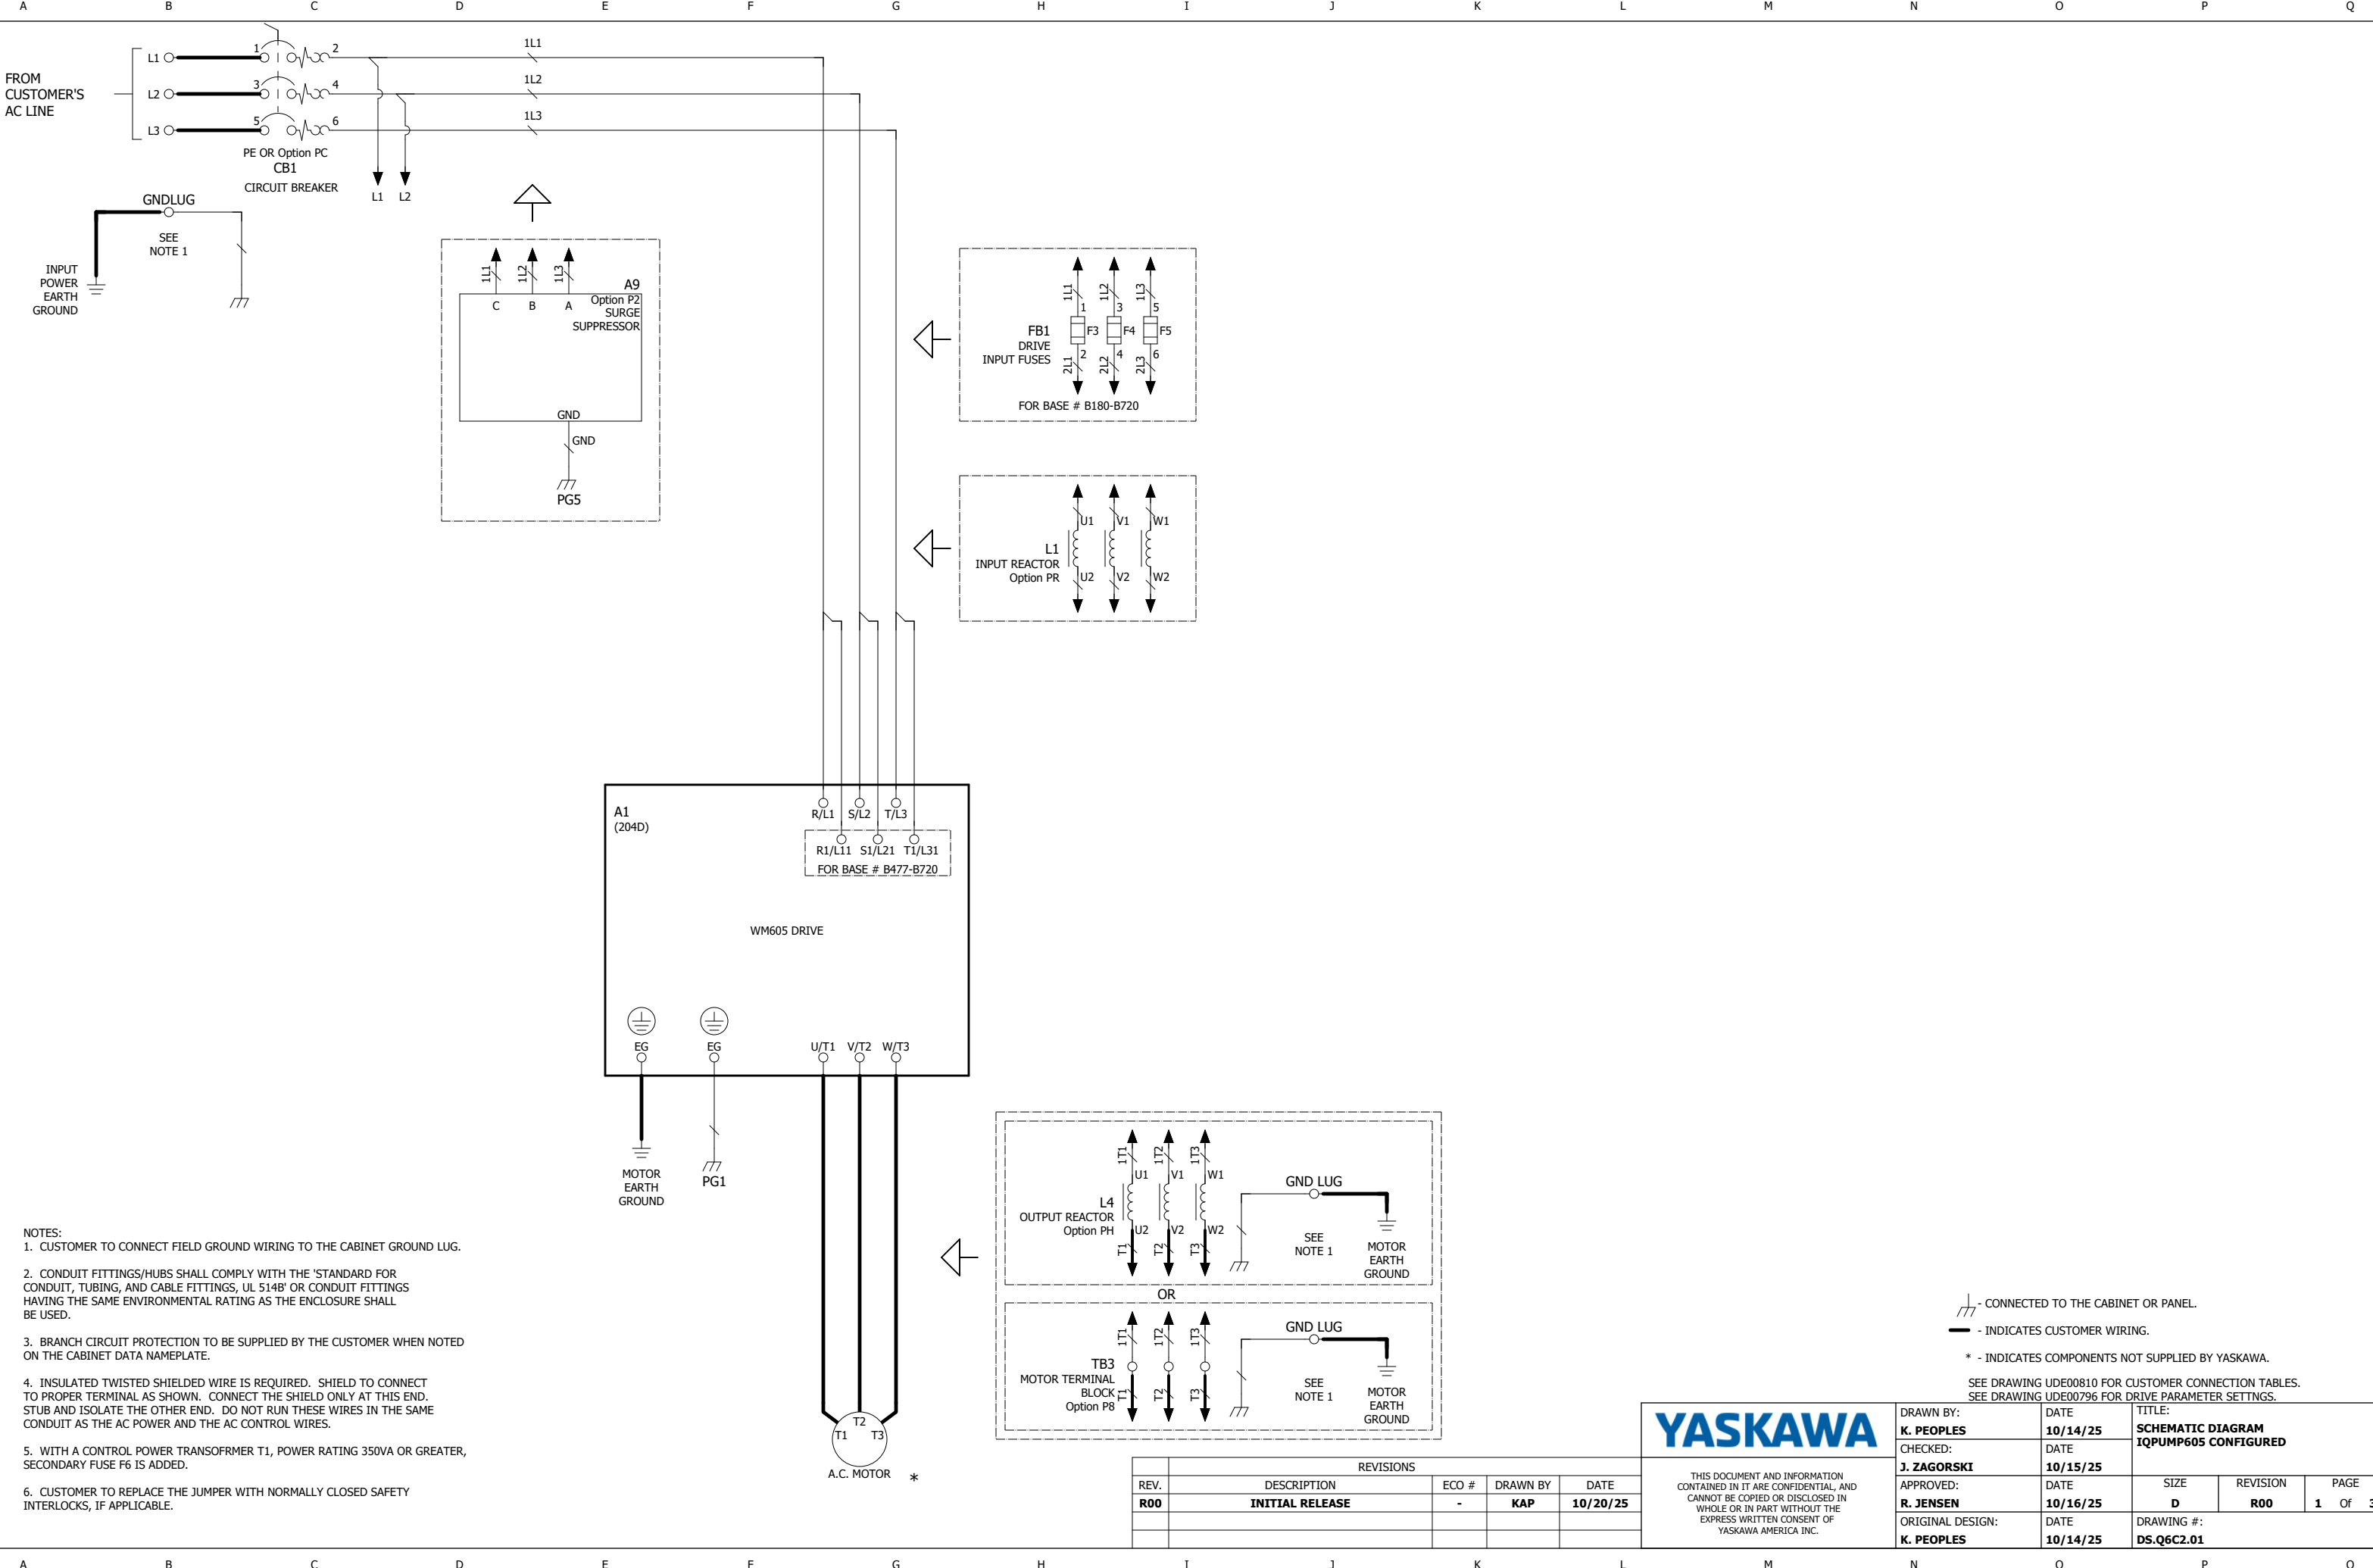

NOTES:

1. CUSTOMER TO CONNECT FIELD GROUND WIRING TO THE CABINET GROUND LUG.


2. CONDUIT FITTINGS/HUBS SHALL COMPLY WITH THE 'STANDARD FOR CONDUIT, TUBING, AND CABLE FITTINGS, UL 514B' OR CONDUIT FITTINGS HAVING THE SAME ENVIRONMENTAL RATING AS THE ENCLOSURE SHALL BE USED.

3. BRANCH CIRCUIT PROTECTION TO BE SUPPLIED BY THE CUSTOMER WHEN NOTED ON THE CABINET DATA NAMEPLATE.

4. INSULATED TWISTED SHIELDED WIRE IS REQUIRED. SHIELD TO CONNECT TO PROPER TERMINAL AS SHOWN. CONNECT THE SHIELD ONLY AT THIS END. STUB AND ISOLATE THE OTHER END. DO NOT RUN THESE WIRES IN THE SAME CONDUIT AS THE AC POWER AND THE AC CONTROL WIRES.



5. WITH A CONTROL POWER TRANSOFRMER T1, POWER RATING 350VA OR GREATER, SECONDARY FUSE F6 IS ADDED.

6. CUSTOMER TO REPLACE THE JUMPER WITH NORMALLY CLOSED SAFETY INTERLOCKS, IF APPLICABLE.

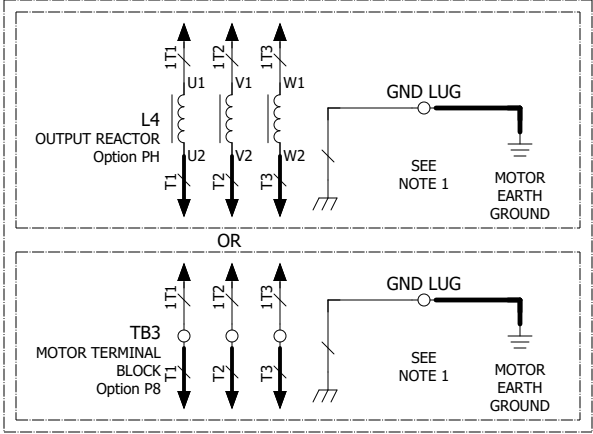

REVISIONS				
REV.	DESCRIPTION	ECO #	DRAWN BY	DATE
R00	INITIAL RELEASE	-	KAP	10/20/25

YASKAWA THIS DOCUMENT AND INFORMATION CONTAINED IN IT ARE CONFIDENTIAL, AND CANNOT BE COPIED OR DISCLOSED IN WHOLE OR IN PART WITHOUT THE EXPRESS WRITTEN CONSENT OF YASKAWA AMERICA INC.	DRAWN BY: K. PEOPLES	DATE 10/14/25	TITLE: SCHEMATIC DIAGRAM IQPUMP605 CONFIGURED		
	CHECKED: J. ZAGORSKI	DATE 10/15/25			
	APPROVED: R. JENSEN	DATE 10/16/25	SIZE D	REVISION R00	PAGE 1 Of 3
	ORIGINAL DESIGN: K. PEOPLES	DATE 10/14/25	DRAWING #: DS.Q6C2.01		

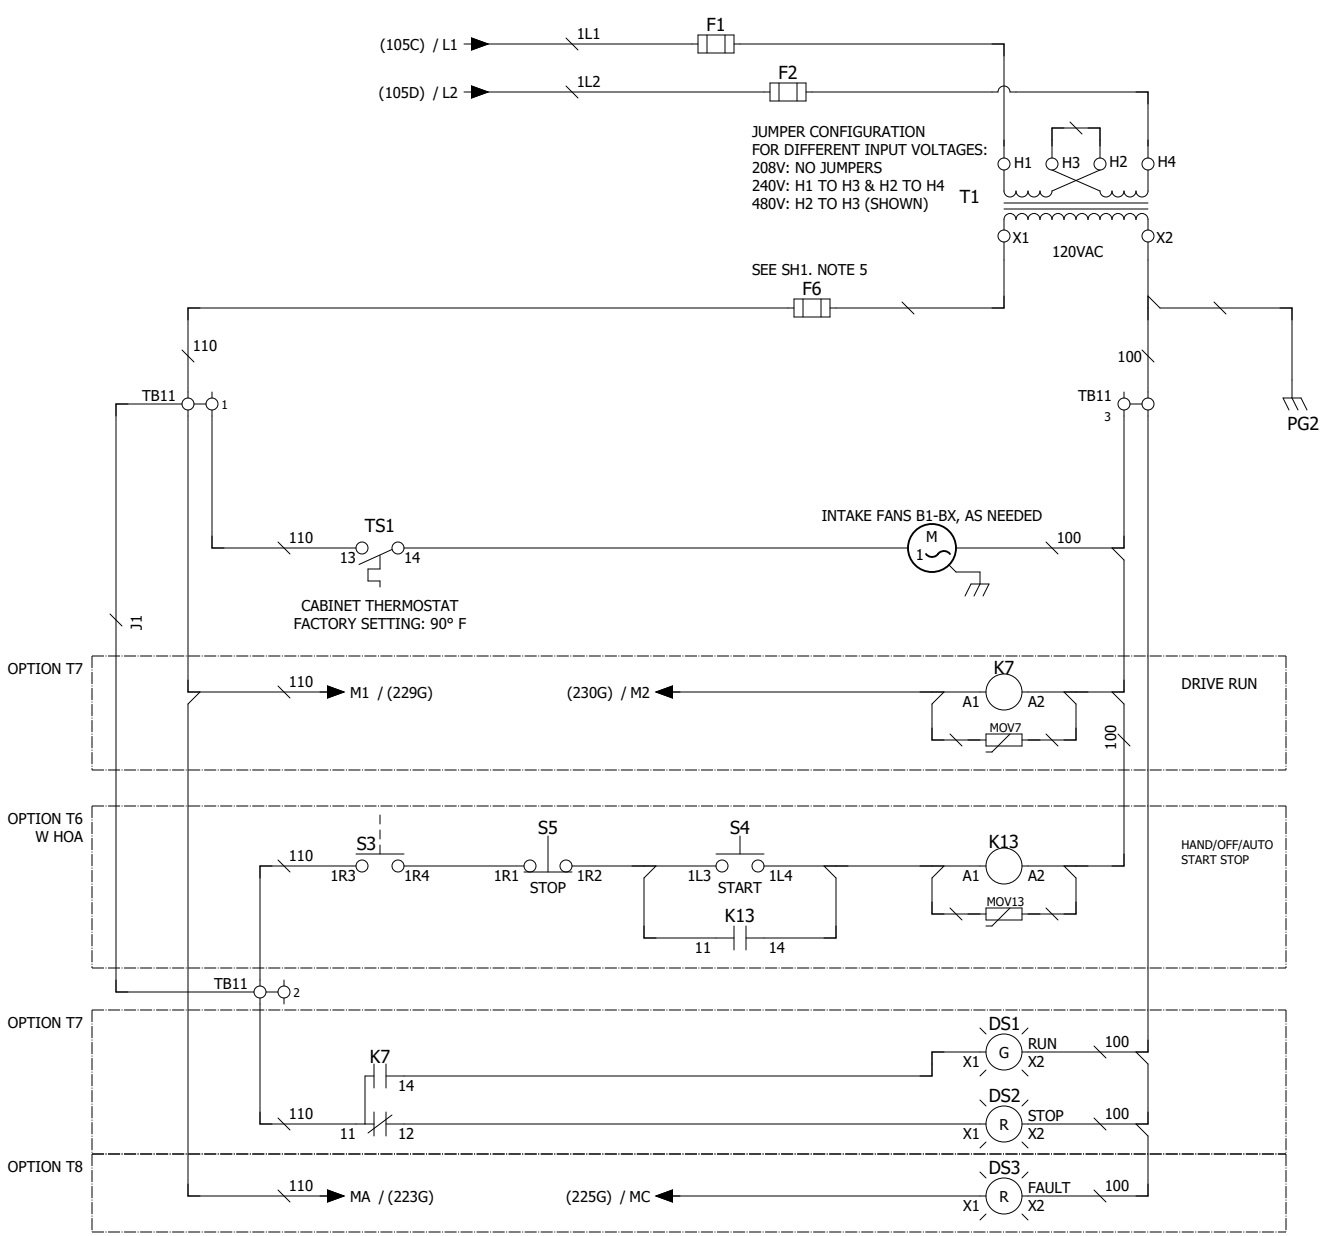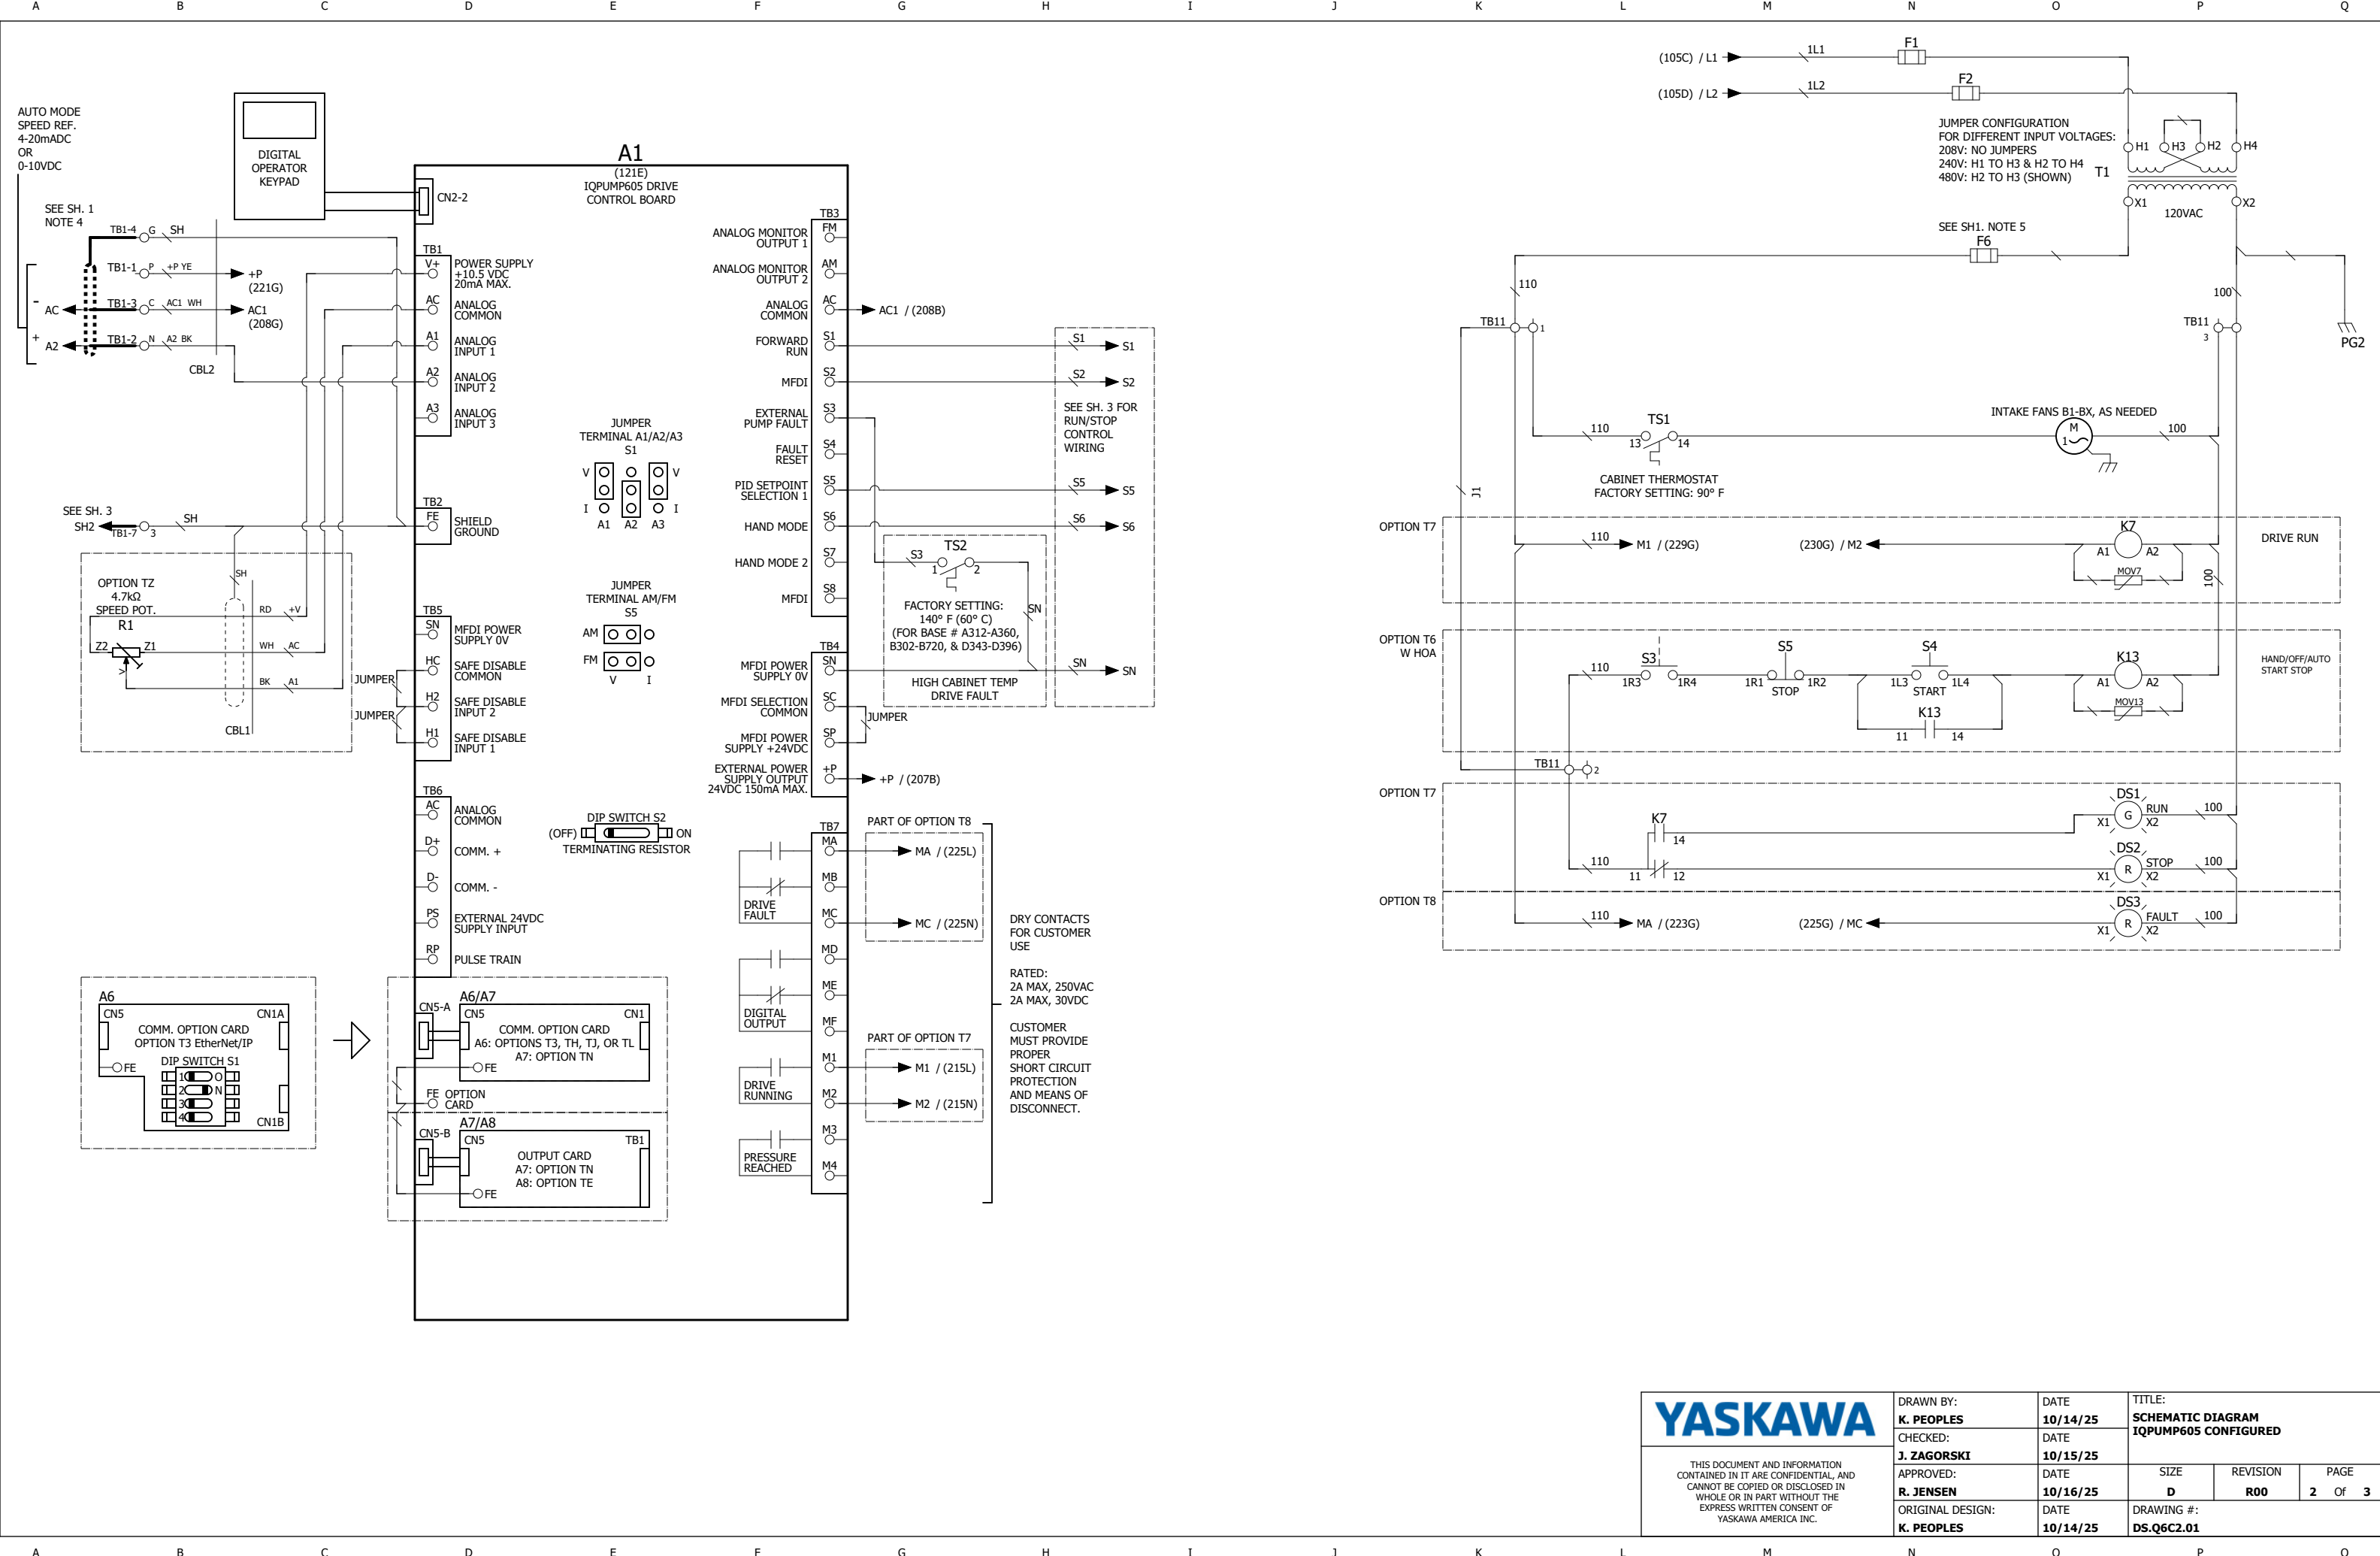

YASKAWA THIS DOCUMENT AND INFORMATION CONTAINED IN IT ARE CONFIDENTIAL, AND CANNOT BE COPIED OR DISCLOSED IN WHOLE OR IN PART WITHOUT THE EXPRESS WRITTEN CONSENT OF YASKAWA AMERICA INC.	DRAWN BY: K. PEOPLES	DATE 10/14/25	TITLE: SCHEMATIC DIAGRAM IQPUMP605 CONFIGURED		
	CHECKED: J. ZAGORSKI	DATE 10/15/25			
	APPROVED: R. JENSEN	DATE 10/16/25	SIZE D	REVISION R00	PAGE 2 Of 3
	ORIGINAL DESIGN: K. PEOPLES	DATE 10/14/25	DRAWING #: DS.Q6C2.01		

