

Application Note

Adding an MPiec Controller as an EtherNet/IP Adapter to Allen Bradley CompactLogixL32E

Applicable Product: MPiec, CompactLogix5332E

Yaskawa Electric America
2121 Norman Drive South
Waukegan, IL 60085
1-800-927-5292

Subject: Application Note	Product: MPiec	Doc#: AN.MCD.08.110
Title: Adding an MPiec as an EtherNet/IP Adapter to AllenBradley CompactLogix5332E		

1.	Application Overview	3
2.	Application Requirements	3
3.	Application Solution and Benefits.....	3
4.	System layout	4
5.	Configuring the Scanner (AB CompactLogix 5332E)	4
6.	Configuring the Adapter (MPiec).....	13
7.	Communication Verification	18

Subject: Application Note	Product: MPiec	Doc#: AN.MCD.08.110
Title: Adding an MPiec as an EtherNet/IP Adapter to AllenBradley CompactLogix5332E		

1. Application Overview

This application note illustrates how to add an MPiec motion controller as an EtherNet/IP Adapter (Generic EIP Device) to Allen Bradley's CompactLogix 5332E using RSLogix 5000 PLC application software and MotionWorksIEC. Additionally, a detailed description of how to create, link and verify communication via I/O variables is provided.

2. Application Requirements

The requirements for this application note include using the MPiec motion controller as an EIP Adapter (Slave) device to talk to and exchange data with an Allen Bradley CompactLogix PLC Scanner (Master). The example explained in this note describes an implicit I/O message connection between the MPiec and the AB PLC. No function blocks or PLC logic is necessary, since the data connection is open once the Assembly instances are correctly configured.

Components:

- MPiec Controller
- AB RSLogix5000© version 13.0
- AB CompactLogix 5332E with 1769-L32E Ethernet Port (Revision 13.21)

3. Application Solution and Benefits

- This configuration will allow the user to exchange data between the Allen Bradley CompactLogix 5332E PLC and the MPiec Motion Controller using EtherNet/IP as the protocol.
- Both Input and Output data tags are supported.

Subject: Application Note	Product: MPiec	Doc#: AN.MCD.08.110
Title: Adding an MPiec as an EtherNet/IP Adapter to AllenBradley CompactLogix5332E		

4. System layout

Figure 1 details the goal of this project

Yaskawa MP2300Siec

AB CompactLogix



Figure 1: System Layout

5. Configuring the Scanner (AB CompactLogix 5332E)

This document explains configuration of the EtherNet/IP Module and the EtherNet/IP Assembly instances on both the MPiec device (Adapter) and the AB PLC device (Scanner).

In RSLogix 5000, start a new project. Enter the controller details as shown in Figure 2

Subject: Application Note	Product: MPiec	Doc#: AN.MCD.08.110
Title: Adding an MPiec as an EtherNet/IP Adapter to AllenBradley CompactLogix5332E		

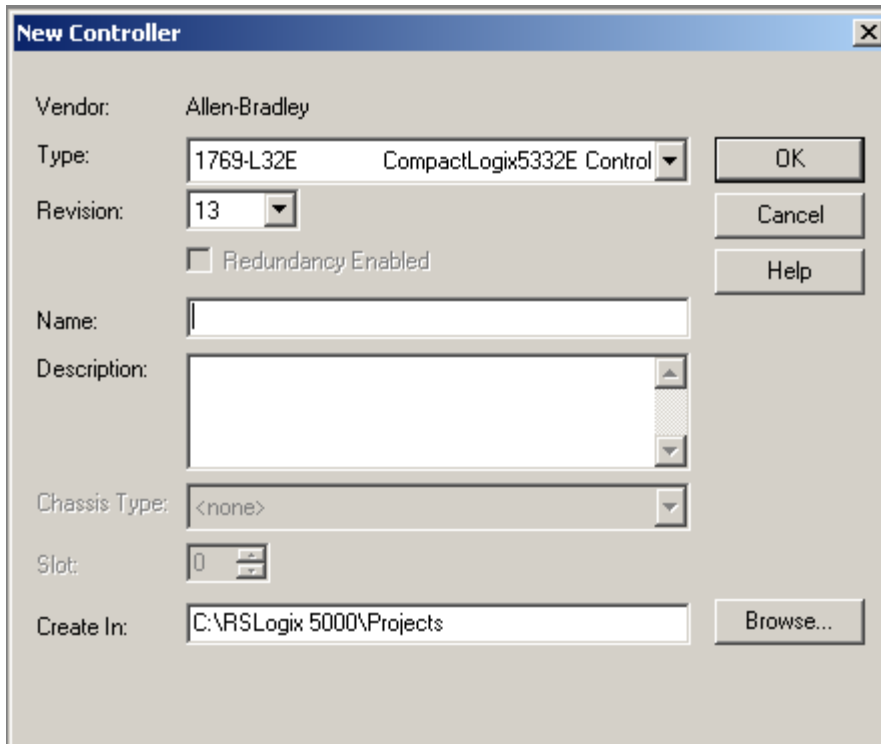


Figure 2: Starting a new project

The next step is to configure the AB PLC with its IP address and verify that all devices on the network are recognized. Since the Ethernet module is built in, double click on the Ethernet port entry under I/O Configuration and enter the IP address of the scanner (CompactLogix PLC). (Figure 3)

Subject: Application Note	Product: MPiec	Doc#: AN.MCD.08.110
Title: Adding an MPiec as an EtherNet/IP Adapter to AllenBradley CompactLogix5332E		

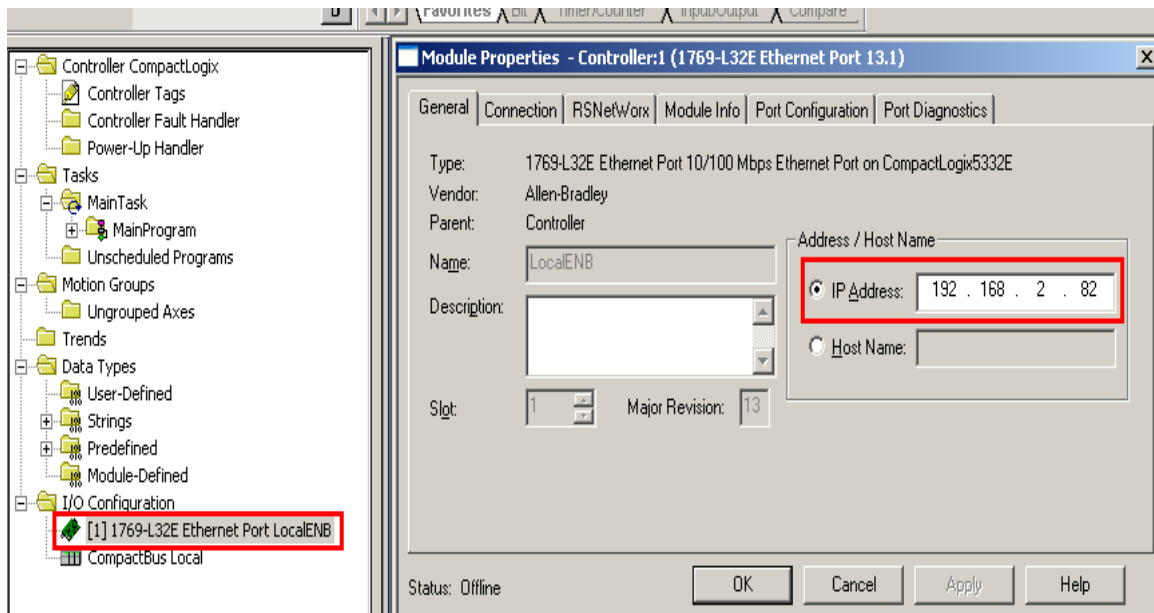


Figure 3: IP address of AB scanner

To verify the devices on the network, click on the communications tab and select 'Who Active'.

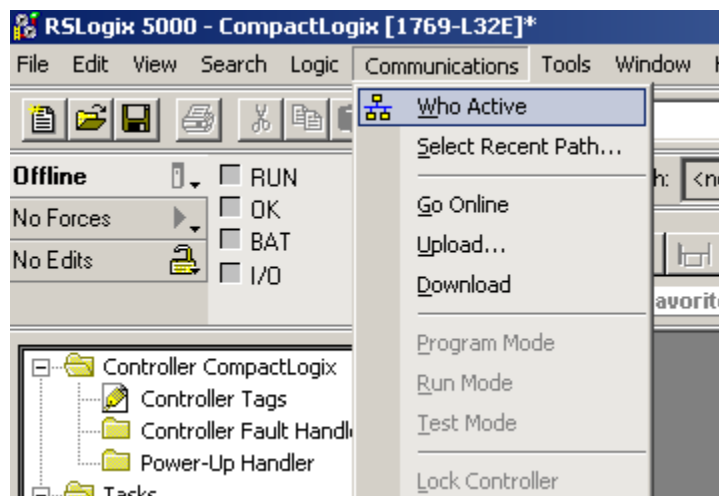


Figure 4: Verification of online devices on the network

Subject: Application Note	Product: MPiec	Doc#: AN.MCD.08.110
Title: Adding an MPiec as an EtherNet/IP Adapter to AllenBradley CompactLogix5332E		

Figure 5 illustrates how the two devices on the network are displayed. The MPiec controller (adapter) is at IP address 192.168.2.1 and the AB scanner PLC is at 192.168.2.82.

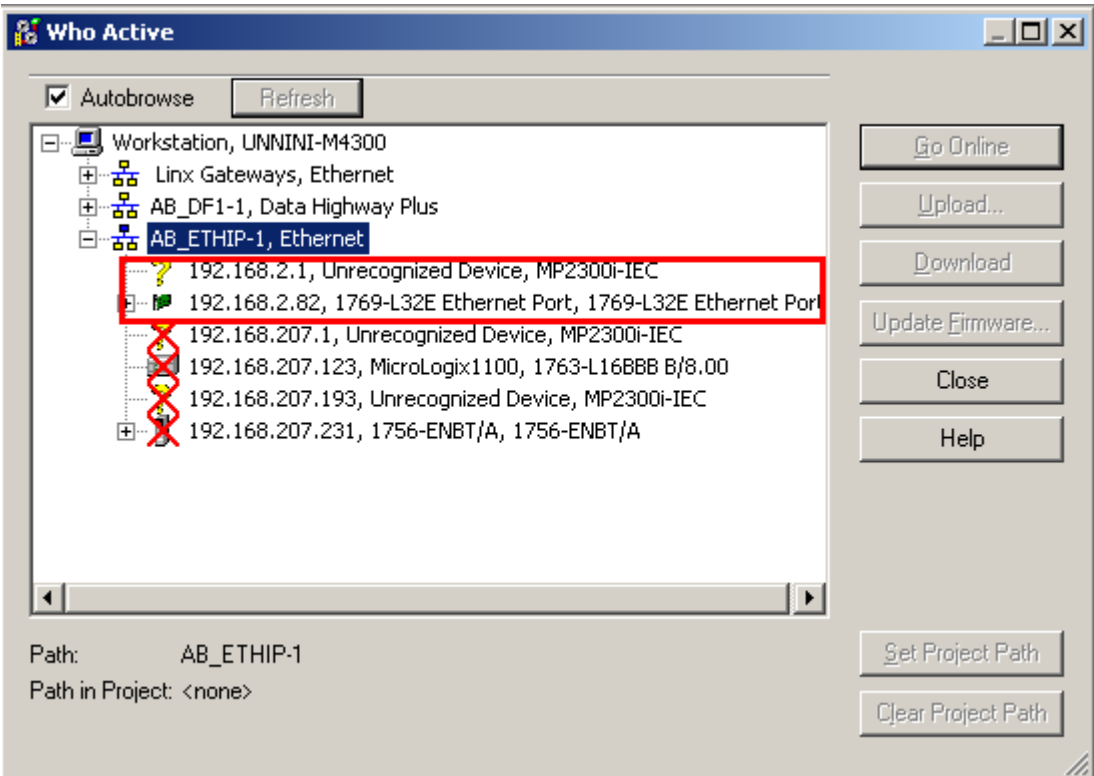


Figure 5: Online devices

Next, the MPiec needs to be added as a Generic EIP device. Right Click on [1] 1769-L32E Ethernet Port Local ENB under I/O Configuration > Click on 'New Module', and select the following from the 'Select Module Type' dialog:

Subject: Application Note	Product: MPiec	Doc#: AN.MCD.08.110
Title: Adding an MPiec as an EtherNet/IP Adapter to AllenBradley CompactLogix5332E		

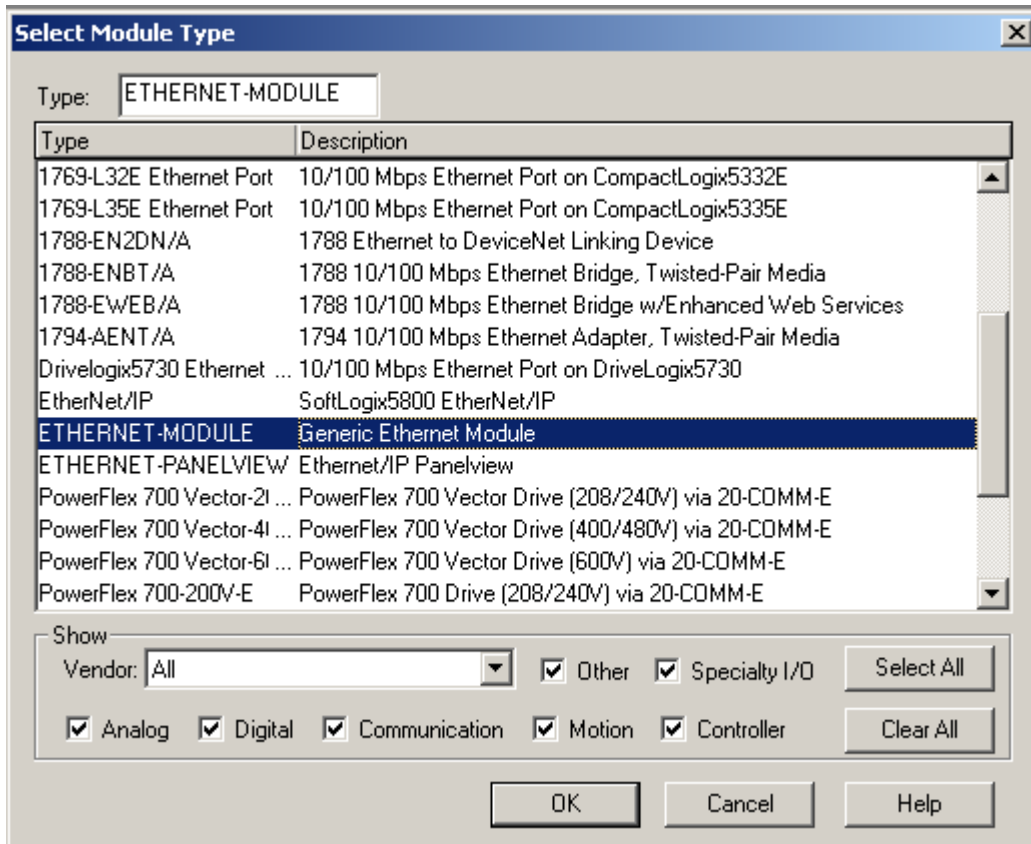


Figure 6: Selecting the adapter module type

Right Click on the newly created ETHERNET-MODULE and edit the properties as shown in Figure 7

Subject: Application Note	Product: MPiec	Doc#: AN.MCD.08.110
Title: Adding an MPiec as an EtherNet/IP Adapter to AllenBradley CompactLogix5332E		

The following dialog should be displayed to configure the MPiec EIP Adapter:

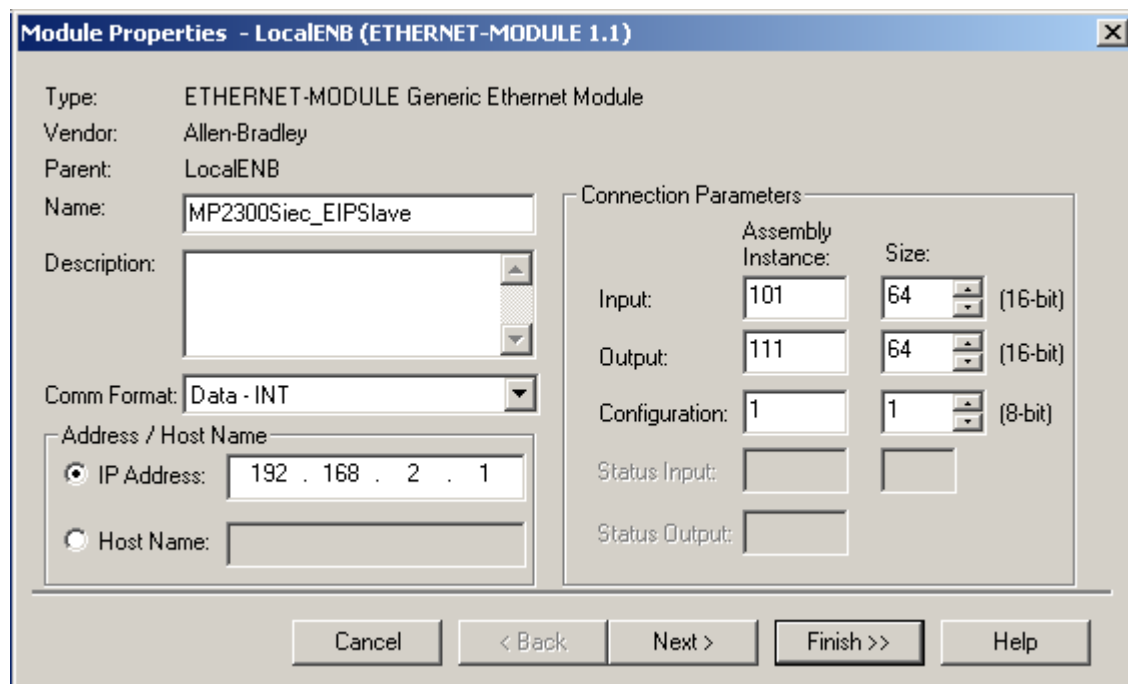


Figure 7: Ethernet Module (adapter) properties

Notes about the Generic Ethernet Device Properties:

1. IP Address is for the EIP Adapter.
2. Assembly Instances are referenced to the Master, meaning Input in this context is input to the Scanner (Master), output to the Adapter (Slave).

Note: Special attention needs to be paid to the assembly instances and their sizes. If the sizes are not compatible, an error in communication will result. In this case sixty four sixteen bit registers make up the 128 bytes that instances 101 and 111 are made up of. This is compatible with the 128 eight bit registers on the MPiec side.

Subject: Application Note	Product: MPiec	Doc#: AN.MCD.08.110
Title: Adding an MPiec as an EtherNet/IP Adapter to AllenBradley CompactLogix5332E		

3. Configuration is not used on the MPiec controller. Therefore, this can be set to Assembly Instance #1, Size 1 since the assembly number can not be left blank.

Finally, configure the RPI (Requested Packet Interval) on the Master to dictate the polling rate to which the Master will update new packet information from the Slave. **The minimum value for the MPiec is 10ms.** Click on the 'Connection' tab in the Module Properties dialog

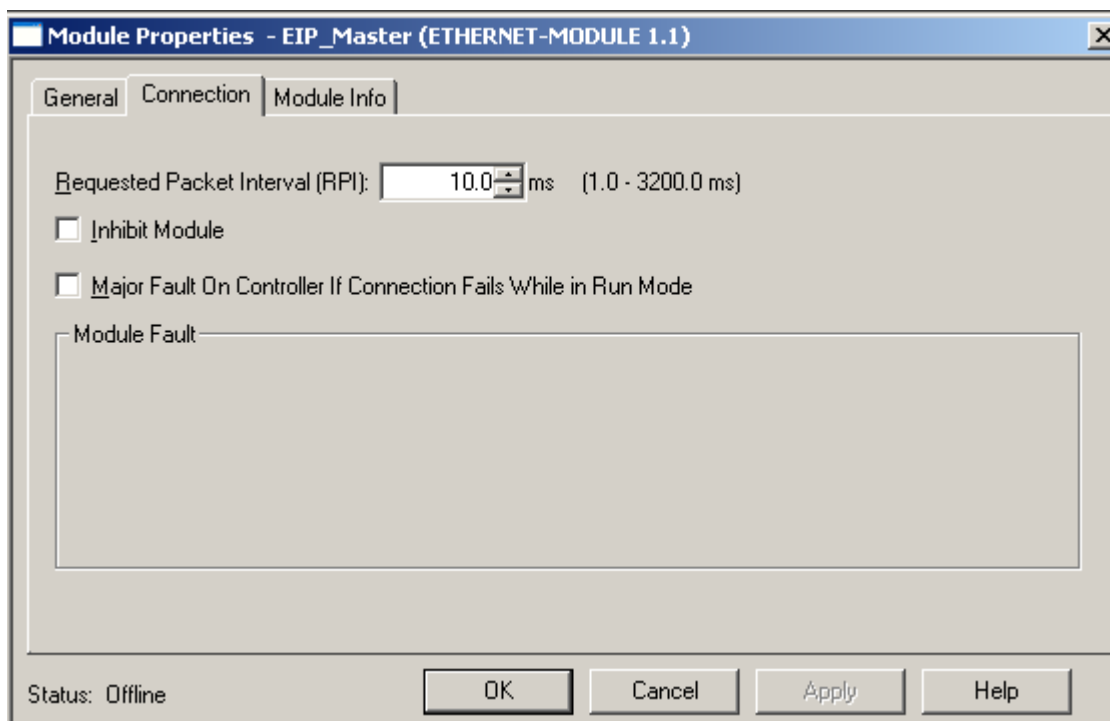


Figure 8: RPI properties

Verify the created project by clicking on the verify button as shown in Figure 9.

Subject: Application Note	Product: MPiec	Doc#: AN.MCD.08.110
Title: Adding an MPiec as an EtherNet/IP Adapter to AllenBradley CompactLogix5332E		

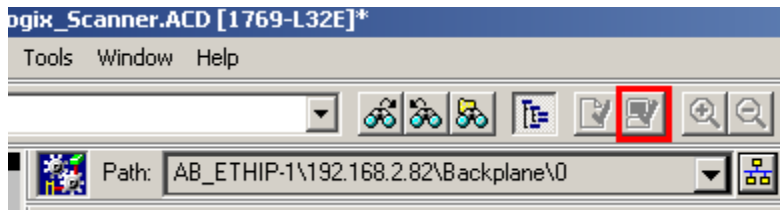


Figure 9: Verify

Download the project to the controller by verifying the path to download. Communications > Who Active



Figure 10: Verify path for download

Select the controller to which this project is going to be downloaded and click download as in Figure 11.

Subject: Application Note	Product: MPiec	Doc#: AN.MCD.08.110
Title: Adding an MPiec as an EtherNet/IP Adapter to AllenBradley CompactLogix5332E		

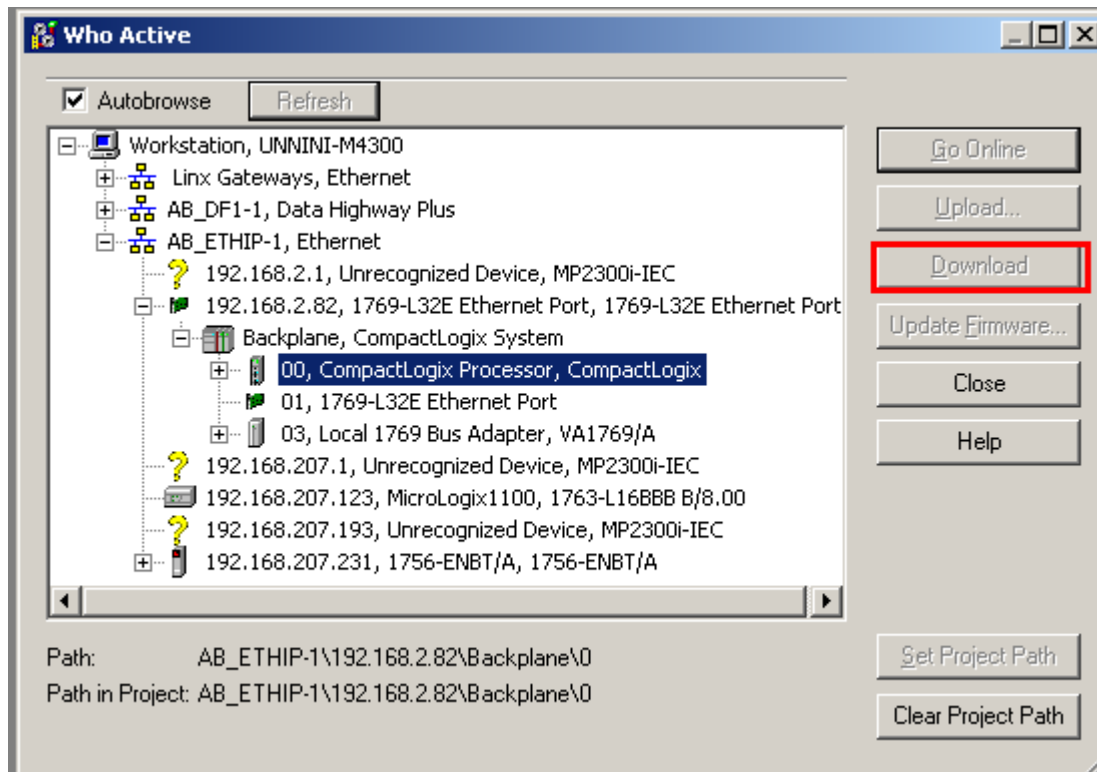


Figure 11: Download to CompactLogix

Once downloaded, go online.

At this point, the scanner device (AB PLC) is configured to talk with the MPiec as an adapter. Additionally, the RSLogix 5000 software automatically adds the words configured for the EIP module. These can be located in the 'Controller Tags' node under the 'Controller' node in the project tree:

Subject: Application Note	Product: MPiec	Doc#: AN.MCD.08.110
Title: Adding an MPiec as an EtherNet/IP Adapter to AllenBradley CompactLogix5332E		

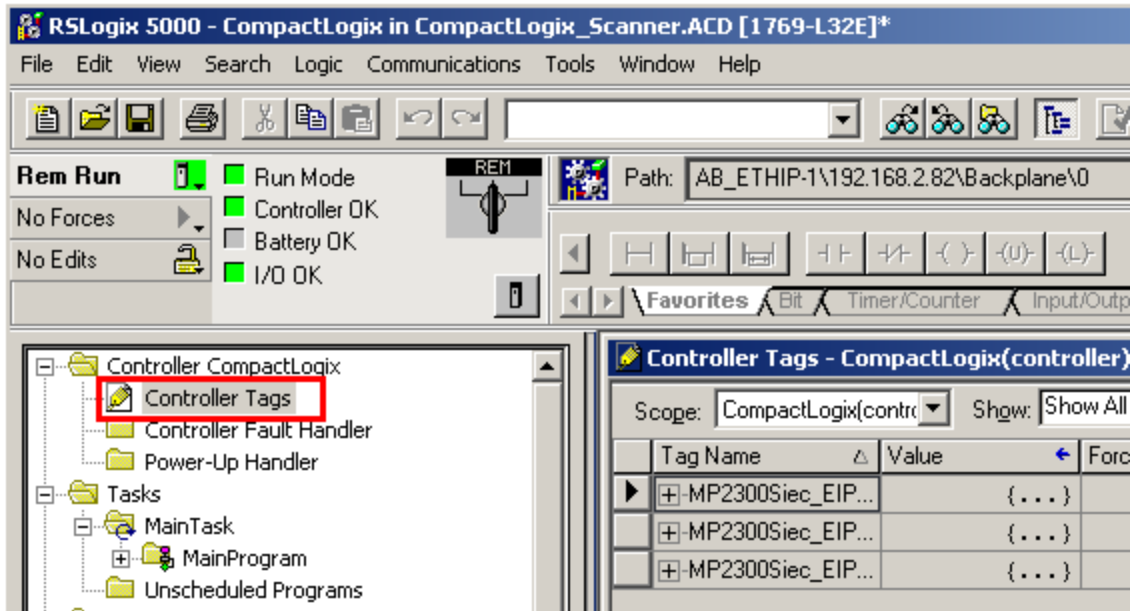


Figure 12: Controller tags for I/O variables

6. Configuring the Adapter (MPiec)

The next steps illustrate how to create a project in MotionWorks IEC and add I/O variables to talk with the AB PLC.

Since Assembly Instances #101 (Scanner Inputs) and #111 (Scanner Outputs) were configured on the scanner device, the next task is to implement the data exchange between the scanner and the adapter. To do this, we need to add I/O variables using the pre-defined address ranges as specified in the MPiec Project Template. This is the template that opens when a user chooses to open a new project in MotionWorksIEC as shown in Figure 13 a.

Subject: Application Note	Product: MPiec	Doc#: AN.MCD.08.110
Title: Adding an MPiec as an EtherNet/IP Adapter to AllenBradley CompactLogix5332E		

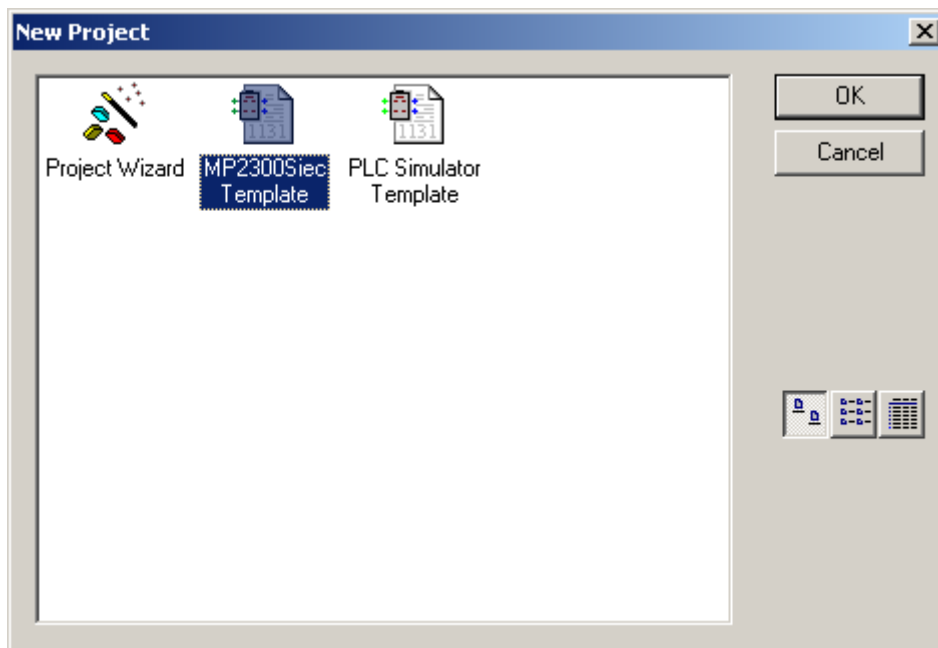


Figure 13 a: New project in MotionWorksIEC

Launch the Configuration tool and verify the IP address of the MPiec adapter device as shown in figures 13 b and c.

Subject: Application Note	Product: MPiec	Doc#: AN.MCD.08.110
Title: Adding an MPiec as an EtherNet/IP Adapter to AllenBradley CompactLogix5332E		

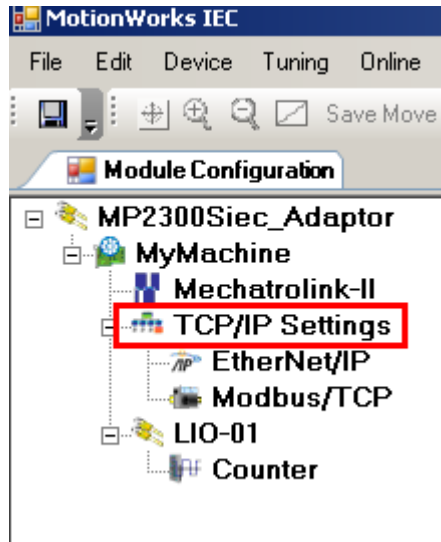


Figure 13 b: Verifying IP settings of MPiec through the CT

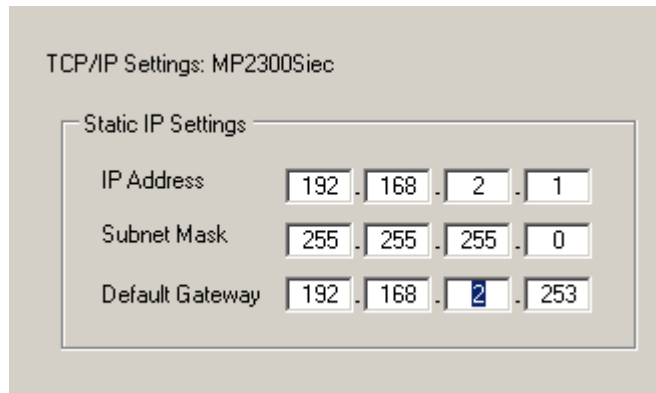


Figure 13 c: IP settings of the MPiec

Verify the IP settings on the web page of the controller after logging into the MPiec web page. This is shown in Figure 13 d.

Note: Pay special attention to ensure that the Default Gateway is set appropriately in both the CT and the web page.

Subject: Application Note	Product: MPiec	Doc#: AN.MCD.08.110
Title: Adding an MPiec as an EtherNet/IP Adapter to AllenBradley CompactLogix5332E		

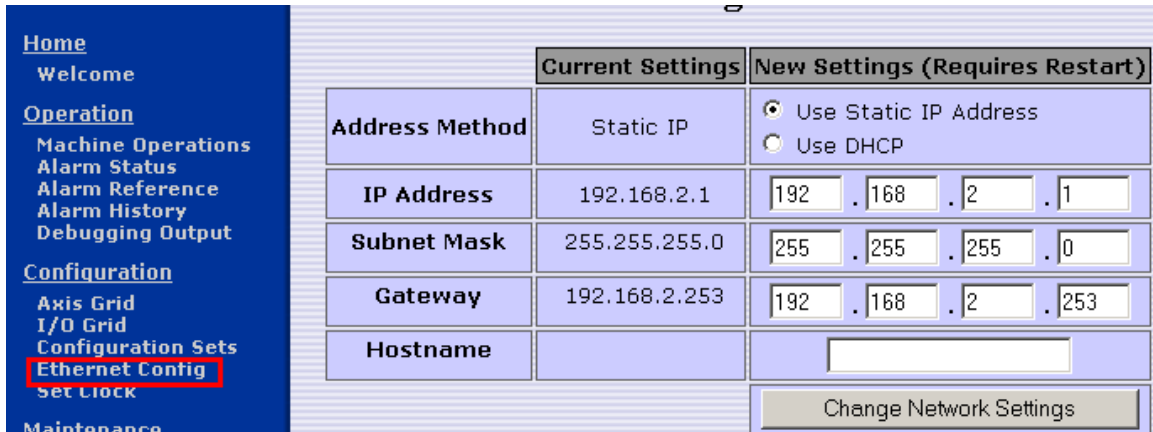


Figure 13 d: IP settings on the MPiec web page

In the MotionWorksIEC new project, select the 'Global_Variables' tab in the Project Tree

Name	Type	Usage	Description	Address	Init
+ System					
[-] EIP Input Instance #111, Qty: 128 Bytes, Address Range: %IB0 - %IB127					
FromCL	INT	VAR_GLOBAL		%IWD	
[-] EIP Input Instance #112, Qty: 256 Bytes, Address Range: %IB128 - %IB383					
[-] EIP Input Instance #113, Qty: 128 Bytes, Address Range: %IB384 - %IB511					
[-] EIP Input Instance #114, Qty: 256 Bytes, Address Range: %IB512 - %QI767					
[-] EIP Input Instance #115, Qty: 128 Bytes, Address Range: %IB768 - %IB895					
[-] EIP Input Instance #116, Qty: 256 Bytes, Address Range: %IB896 - %IB1151					
[-] EIP Output Instance #101, Qty: 128 Bytes, Address Range: %QB0 - %QB127					
ToCL	INT	VAR_GLOBAL		%QWD	
[-] EIP Output Instance #102, Qty: 256 Bytes, Address Range: %QB128 - %QB383					
[-] EIP Output Instance #103, Qty: 128 Bytes, Address Range: %QB384 - %QB511					

Figure 14: Global Variable list

Start adding I/O variables to the Global Variables table. In this example, we will be adding one input INT (16bit) variable and one output INT variable. A new variable can be created by right clicking on the grey input or output instance group name and choosing so.

Subject: Application Note	Product: MPiec	Doc#: AN.MCD.08.110
Title: Adding an MPiec as an EtherNet/IP Adapter to AllenBradley CompactLogix5332E		

Next, we assign each variable an address based on the variable group description range. Note: Addressing in the MotionWorks IEC project is based on byte offset; i.e. %QW0 = Word 0, %QW1 = Word 1, etc.

The exercise carried out in this test project is as follows

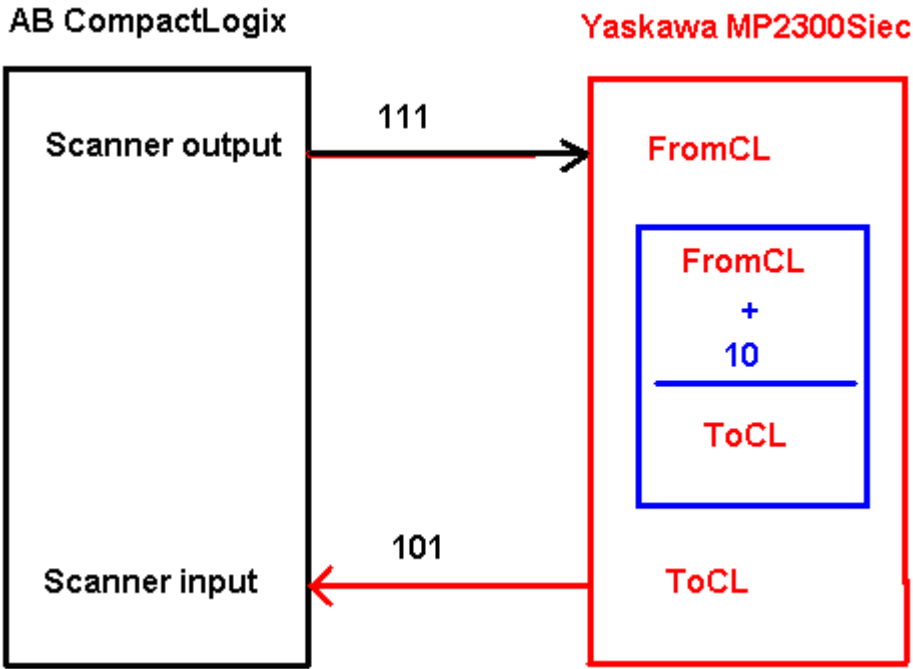


Figure 15: Test exercise

Create the following logic on the slave MPiec controller. Download the program and run the controller.

Subject: Application Note	Product: MPiec	Doc#: AN.MCD.08.110
Title: Adding an MPiec as an EtherNet/IP Adapter to AllenBradley CompactLogix5332E		

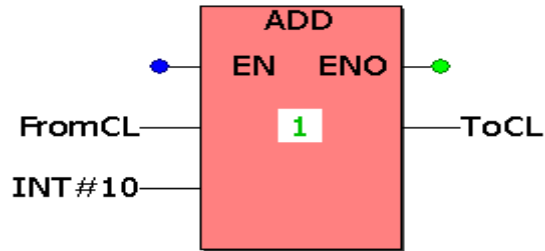


Figure 16: Logic on the MPiec

7. Communication Verification

After both devices and variables are configured, each program can be run and tested using the debuggers on both the Master and Slave devices.

Enter an integer in the scanner output variable

Subject: Application Note	Product: MPieC	Doc#: AN.MCD.08.110
Title: Adding an MPieC as an EtherNet/IP Adapter to AllenBradley CompactLogix5332E		

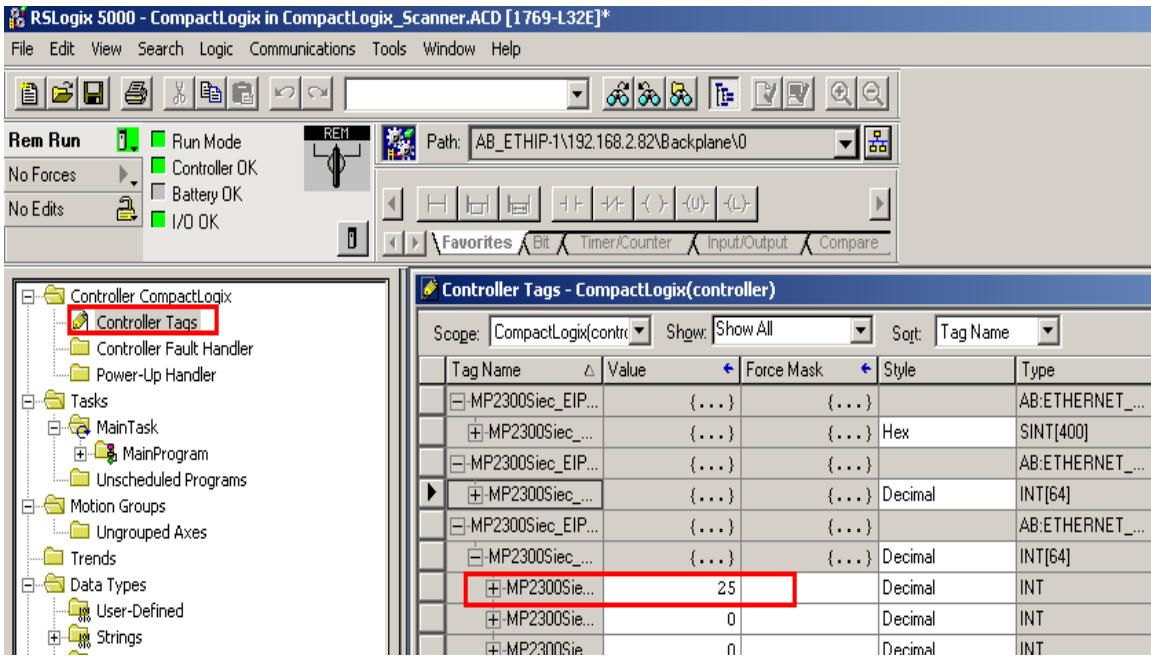


Figure 17: Scanner output variable

In debug mode, one can see the MotionWorksIEC program perform the addition as shown in Figure 17 a.

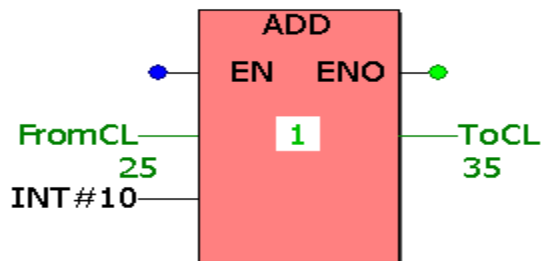


Figure 17 a: Addition in MotionWorksIEC

Subject: Application Note	Product: MPiec	Doc#: AN.MCD.08.110
Title: Adding an MPiec as an EtherNet/IP Adapter to AllenBradley CompactLogix5332E		

The corresponding scanner input variable will have the value of the scanner output variable incremented by one. This addition took place in the MPiec controller.

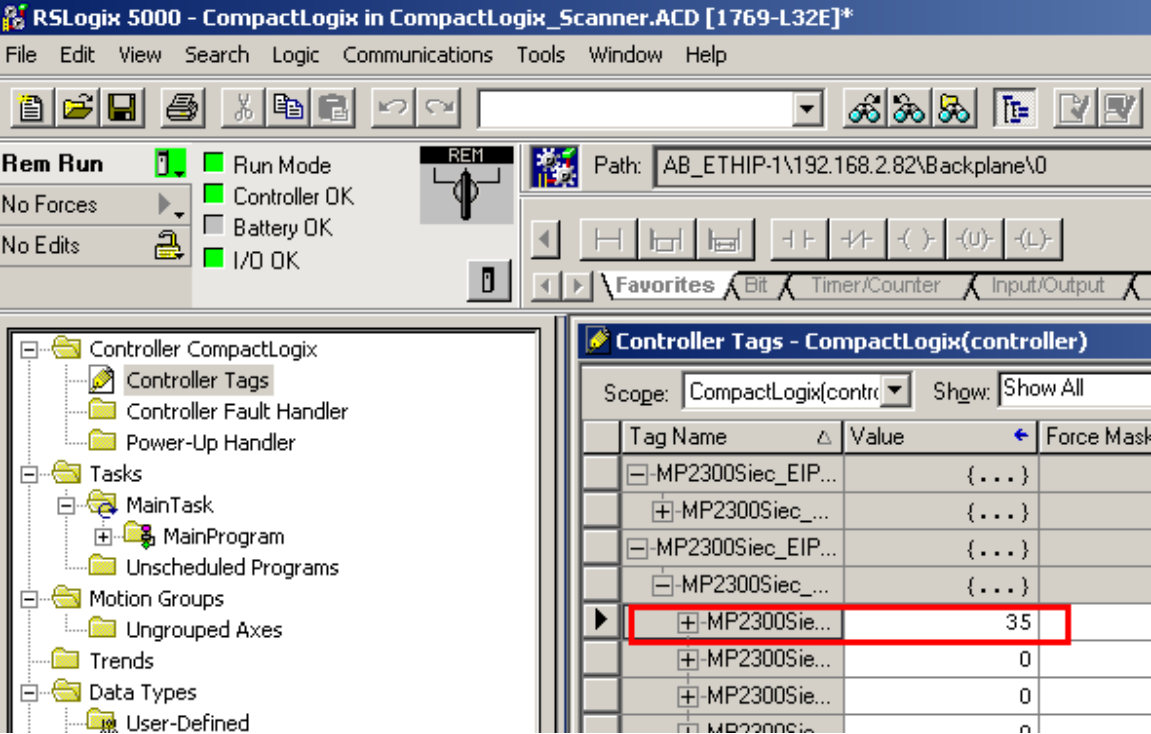


Figure 18: Scanner input variable

To verify the AB PLC has connected correctly to the MPiec controller and the configured Assembly Instances are functioning properly, there is a dialog in RSLogix that displays the status as shown in Figure 19.

Subject: Application Note	Product: MPiec	Doc#: AN.MCD.08.110
Title: Adding an MPiec as an EtherNet/IP Adapter to AllenBradley CompactLogix5332E		

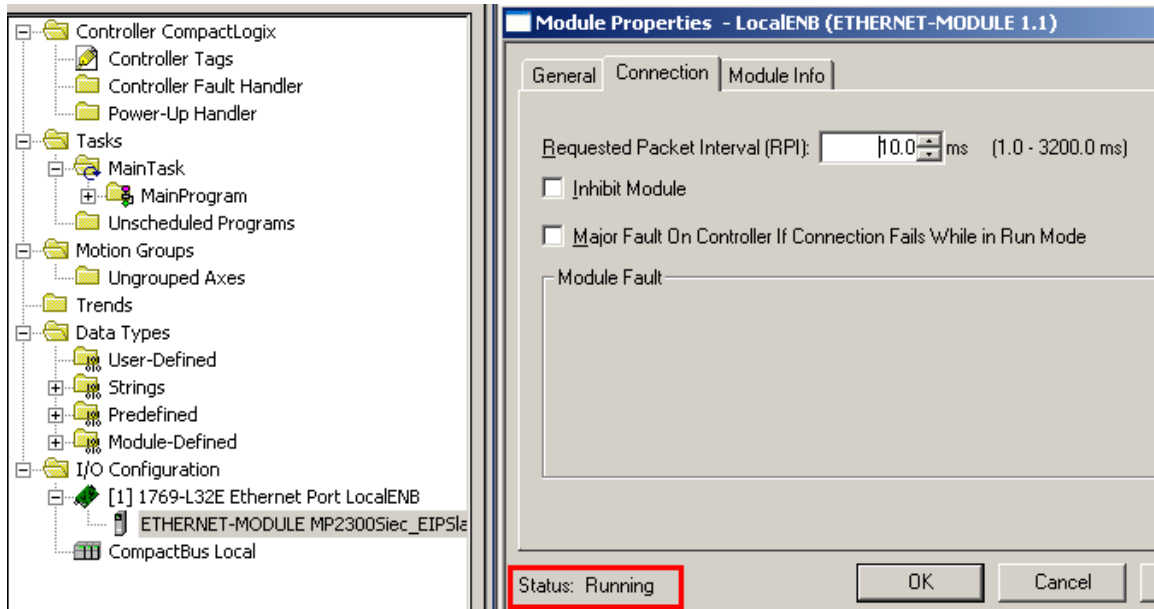


Figure 19: Communication status display