

NOTES:

- A. FOR REFERENCE UNLESS PROPERLY ENDORSED. FOR ADDITIONAL DETAILS AND SPECIFICATIONS, CONSULT YASKAWA AMERICA, INC.
- B. DIMENSIONS ARE IN INCHES [MILLIMETERS]
- C. USE APPROPRIATE TYPE RATED HUBS OR FITTINGS TO MAINTAIN ENCLOSURE RATING.
- D. HATCHED AREA INDICATES PERMISSIBLE CONDUIT ENTRANCE AREA.
- E. IF ENCLOSURE IS MOUNTED USING THE MINIMUM SPECIFIED TOP, BOTTOM, LEFT AND RIGHT CLEARANCES, THEN VENTILATION OPENINGS WILL NEED TO BE PROVIDED AT THE CORNERS AS SHOWN ON PAGE 2.

YASKAWA

THIS DOCUMENT AND INFORMATION CONTAINED IN IT ARE CONFIDENTIAL AND CANNOT BE COPIED OR DISCLOSED IN WHOLE OR IN PART WITHOUT THE EXPRESS WRITTEN CONSENT OF YASKAWA AMERICA, INC.

ORIGINAL DESIGN:
D. Guckenberger

DRAWN:
D. Guckenberger

CHECKED:
P. Johnson

APPROVED:
R. Jensen

DATE:
5/12/2022

DATE:
5/12/2022

DATE:
5/17/2022

DATE:
5/18/2022

TITLE:
**DIMENSION DRAWING,
HV600, NARROW, TYPE 12,
BYPASS, W1**

SIZE:
B

REVISION:
01


PAGE:
1 OF 2


UNITS: **INCHES**

SCALE: **NONE**

DRAWING #:

DD.HB.12.W1.01

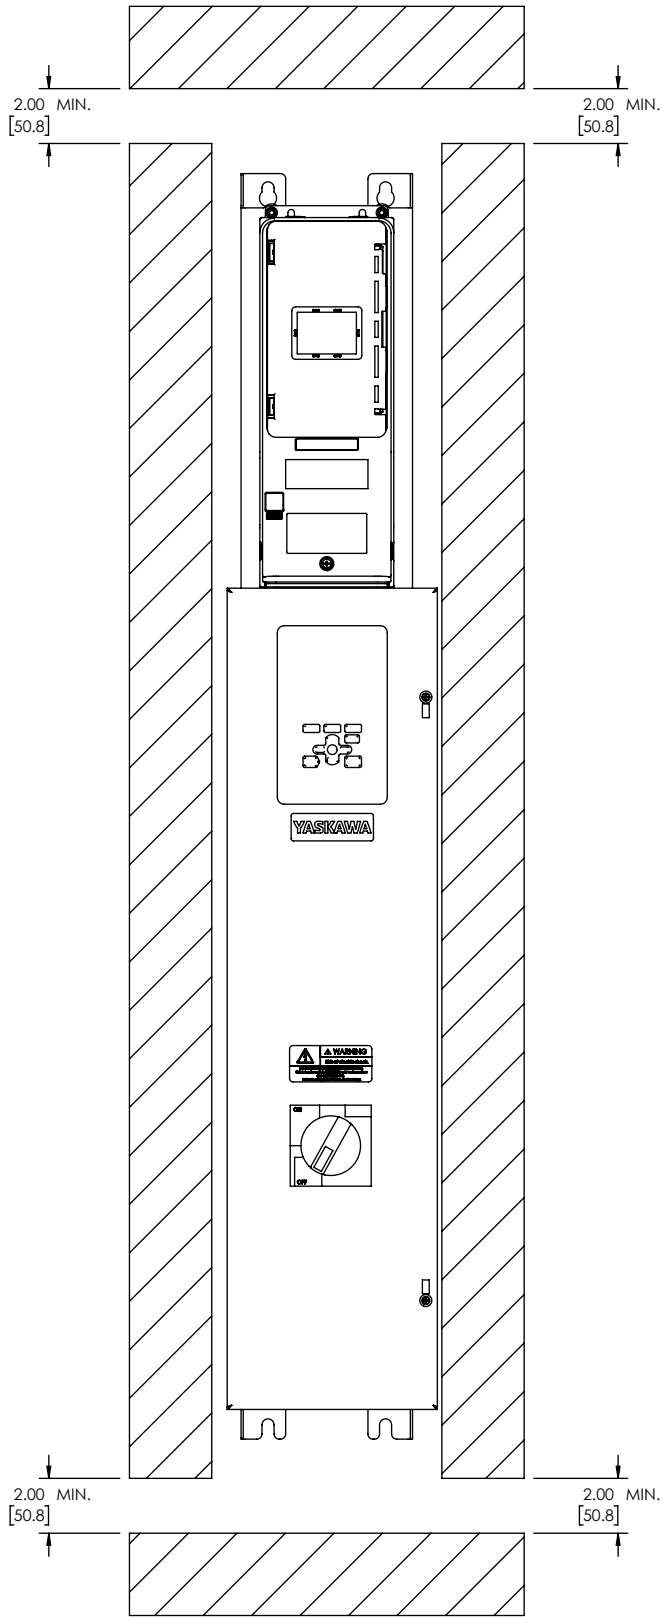

	ORIGINAL DESIGN: D. Guckenberger	DATE: 5/12/2022	TITLE: DIMENSION DRAWING, HV600, NARROW, TYPE 12, BYPASS, W1		
	DRAWN: D. Guckenberger	DATE: 5/12/2022	SIZE: B	REVISION: 01	PAGE: 2 OF 2
<small>THIS DOCUMENT AND INFORMATION CONTAINED IN IT ARE CONFIDENTIAL AND CANNOT BE COPIED OR DISCLOSED IN WHOLE OR IN PART WITHOUT THE EXPRESS WRITTEN CONSENT OF YASKAWA AMERICA INC.</small>	CHECKED: P. Johnson	DATE: 5/17/2022	DRAWING #:		
	APPROVED: R. Jensen	DATE: 5/18/2022	DD.HB.12.W1.01		
UNITS: INCHES	SCALE: NONE				